

Europe

Italy

CHINT Electrics Europe S.R.L.

Add: Via A. Pacinotti 28, 30033 Noale (VE)
Tel: 0039 335 6265 032
E-mail: chint_eu@chint.com

Czech Republic

NOARK Electric Europe s.r.o.

Add: Sezemická 2757/2, 193 00 Prague
Tel: +420 226 203 120
Email: Europe@noark-electric.com
www.noark-electric.eu

North America

United States

NOARK Electric (USA) Inc.

Add: 2188 Pomona Blvd., Pomona, CA 91767
Tel: 626-330-7007
Fax: 626-330-8035
E-mail: nasales@noark-electric.com
na.noark-electric.com

West Asia & Africa

U.A.E

CHINT West Asia & Africa FZE

Add: Office NO. LB182406, P.O.Box:263174, Jebel Ali, Dubai,
United Arab Emirates
Tel: 00971-48848286
Fax: 00971-48848287
E-mail: chintwaa@chint.com

Spain

CHINT Electrics S.L.

Add: Calle José Echegaray, Num 8, Parque Empresarial Las Rozas
Edificio 3, Planta 1º, Oficina 3.C.P: 28232 Las Rozas (Madrid)
Tel: 0034 91 636 59 98
Fax: 0034 91 645 95 82
E-mail: info@chintelectrics.es

Russia

ООО «Чинт Электрик»

Адрес: РФ, 109089, г. Москва, ул. Угрешская, д.2, стр.3, оф.17
Тел.: +7 495 665 6340
Факс: +7 495 665 6340
Email: cis@chint.com

Latin America

Brazil

CHINT Electrics South America Ltd

Add: Av. Paulista, 1765 - Edifício Scarpa-Conj.22
Bela Vista - CEP 01311-200 - São Paulo - SP
Tel: 0055-11-3266-7654
E-mail: chintlatinamerica@chint.com, xjie@chint.com

Asia Pacific

China

Zhejiang CHINT Electrics Co., Ltd

Add (Shanghai): Bldg.2, No.3255 Sixian Road, Songjiang 201614 P.R.China
Tel: 0086-21-67777706
Fax: 0086-21-67777777-88225
E-mail: asiapacific@chint.com, lwgen@chint.com



CHINT
CHINT ELECTRIC

ZHEJIANG CHINT ELECTRICS CO.,LTD.

Add: No. 1, CHINT Road, CHINT Industrial Zone, North Baixiang,
Yueqing, Zhejiang, 325603, P.R.China
Tel: +86-4001177797
Fax: +86-577-62775769 62871811
E-mail: global-sales@chint.com
Website: http://next.chint.com/




© CHINT Electric All Rights Reserved

Recycle Paper Printed



Specifications and technical data are subject to change without notice.
Please contact us to confirm relevant information on ordering

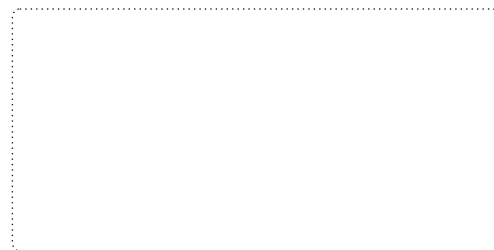

Oct. 2019

© CHINT . NO. EN K03

CHINT | **Next**
CHINT ELECTRIC | series

The Next Reliable Choice

Air Circuit Breaker

CHINT•Empower the World



Founded in 1984, CHINT Group is a well-known enterprise in Chinese industrial electric appliance and new energy sectors. With total assets of over 60 billion RMB and more than 30 thousand employees, the company is running business that covers the power equipment industrial chain including power generation, storage, transmission, transformation, distribution, and consumption. The company is also operating in the fields of urban rail traffic, energy equipment manufacturing, new energy storage materials, Energy Internet, investment & financing platform, and business incubator. The products have been sold to over 130 countries and regions around the world, and have entered main component markets in Europe, Asia, Middle East, and Africa.

CHINT ranks among top 500 private enterprises in China for a few consecutive years, and the amount of tax payable can be regarded as a model for the manufacturing enterprises in Wenzhou. Zhejiang CHINT Electric Appliance Corporation under CHINT Group is a well-known enterprise in China's low voltage electrical appliance industry, and also A-share listed company. CHINT Solar has built over a hundred photovoltaic power stations around the world, it is an influential power station investor and operator in domestic private enterprises.

CHINT has always following the policies of innovation-driven industrial development. Among all competitors, it passed ISO9001 quality system certification, ISO 14001 environment system certification, and OHSAS18001 occupational health safety management certification. The group also holds China Compulsory Certificate (CCC), international CB safety certificate, US UL certificate, Finland FI certificate, Belgium CEBEC certificate, Netherland KEMA certificate, and Germany VDE certificate. The group now owns over 1000 domestic and foreign patents, and has participated in establishment and revision of over 120 industrial standards. Its HV and LV electric appliances and photovoltaic inverters won Germany Red Dot Award. CHINT led development of critical manufacturing equipment PECVD, LPCVD, and MOCVD for China's silicon based thin film photovoltaic cells, which has significantly improved semiconductor equipment manufacturing level in China.

The group has won a number of awards including China Industrial Award, National Quality Management Award, China Excellent Private Science & Technology Enterprise, China Top Ten Machinery Manufacturers with Core Competitiveness, China Top Ten Leading Private Enterprises with Independent Innovation Capabilities, China Contract-Fulfilling and Trustworthy Enterprise, National Advanced Private Enterprise for Employment and Social Security, and China Charity Award.

In the future, CHINT will march towards the targets of creating world famous brands and contributing to an industrial power. It will focus on building the Energy Internet and becoming a smart energy developer and operator. The group will make great efforts to implement three policies: globalization, M&A and integration, and smart manufacturing. Four platforms will be created, including scientific innovation and industrial incubation platform, online industrial and civil Internet of Things platform, online & offline supply chain interaction platform, and investment & financing and payment platform. Four industrial clusters will also be developed, including smart electrical system solution industrial cluster for smart grid, industrial automation information cluster for smart cities, clean energy, environment protection, and energy conservation industrial cluster for smart micro-grid, high-tech material information technology and high-end equipment industrial cluster for smart manufacturing, and Internet of Things IT and smart home industrial group for smart business.

Air Circuit Breaker



Built-in busbar temperature sensor, to control every aspect

Monitors, displays and forecasts the temperature of busbar in real time, with risk clear at a glance and security under control.



With a USB port for better human-machine interaction

Connected with PC or mobile devices through the USB port, lets you manage functions such as data reading, parameter setting, on-line detection and failure recording.



More detailed division of frame size, can fully cover various demands

With a frame size of 1600A, 2000A, 3200A, 4000A, 6300A, it provides a more cost-effective choice.



Absolute adaptability, with steady and reliable operation in extreme conditions

-45°C/+70°C operating temperature range. Meets several applications requirements.

Real-time temperature sensor

Continuous function monitoring
More accurate risk identification




Content


NXA series air circuit breaker	P-01
Overview	P-03
Product selection	P-05
Functions and features	P-09
Technical parameters	P-09
Intelligent controller	P-11
Protection feature	P-15
Measurement precision of the intelligent controller	P-17
Accessories	P-19
Capacity derating and power loss	P-23
Dimension of busbar	P-26
Installation and wiring	P-29
Dimensions and installation	P-29
Secondary circuit wiring	P-51
Annex	P-56
I Configuration	P-56
II Selection table	P-57
III Earth fault protection	P-58
IV Source-changeover controller	P-61

NXA series air circuit breaker

Structural features of the circuit breaker

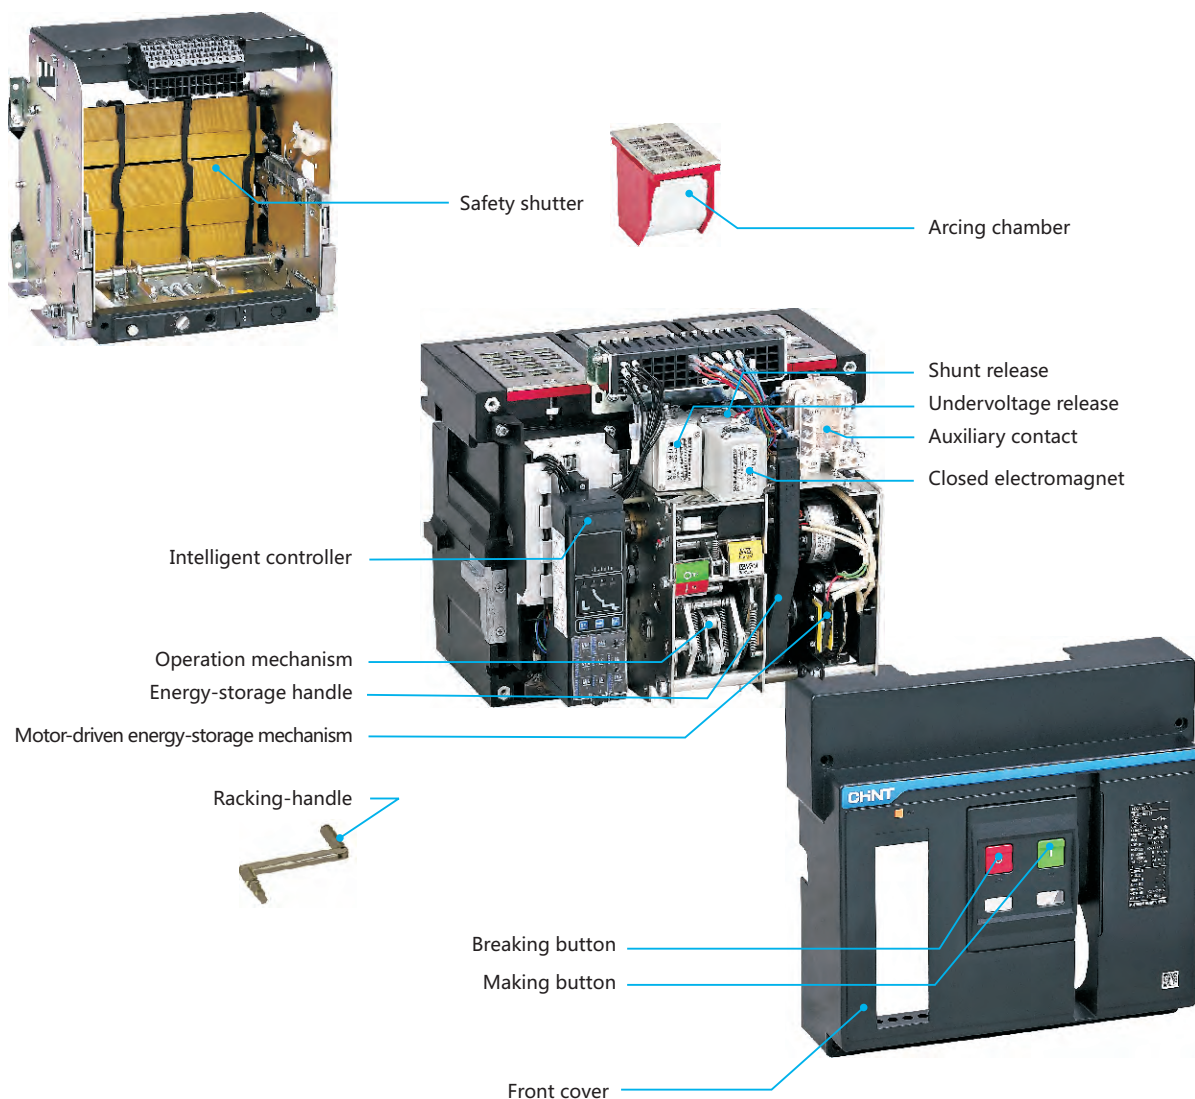

Circuit breaker description

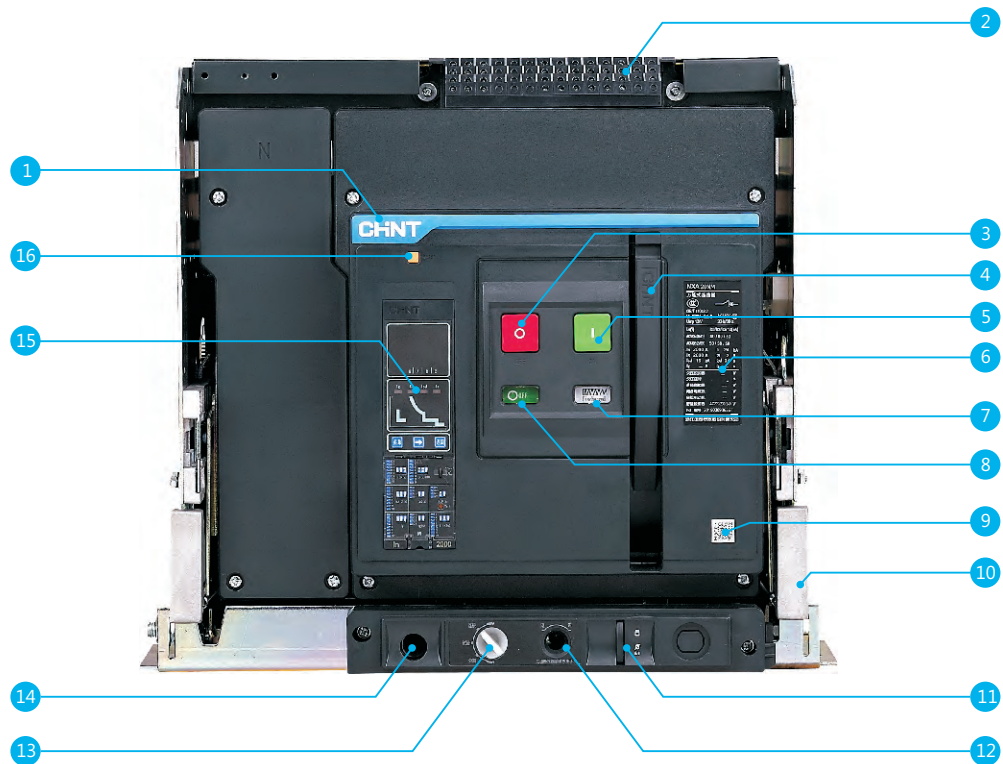

- | | |
|------------------------------------|---|
| 1 Trademark | 9 QR code |
| 2 Secondary wiring terminal | 10 Extraction draw plate (only applicable to draw-out type) |
| 3 Breaking button | 11 "Disconnected" position locking (only applicable to draw-out type) |
| 4 Energy-storage handle | 12 Racking-handle entry (only applicable to draw-out type) |
| 5 Making button | 13 Position indication (only applicable to draw-out type) |
| 6 Nameplate | 14 Racking-handle storage (only applicable to draw-out type) |
| 7 Energy-storage/release indicator | 15 Intelligent controller |
| 8 Breaking/making indicator | 16 Fault-breaking indicator reset button |

Overview



Circuit breaker

- Frame size (A): 1600, 2000, 3200, 4000, 6300
- Breaking capacity: N,S,H
- Rated operational voltage U_e (VAC): 380/400/415, 440/525/690
- Number of poles: 3P, 4P
- Installation method: draw-out type, fixed type



Operation conditions and environment adaptability

- Operation temperature:
The electrical and mechanical characteristics are applicable to the ambient temperature of -5°C ~ $+40^{\circ}\text{C}$. NXA can also operate in the ambient temperature of -45°C ~ $+70^{\circ}\text{C}$ (M type, A type), -20°C ~ $+70^{\circ}\text{C}$ (P type, H type, CD-1), the derating factor is seen in P23-24.
- Storage conditions: apply to -45°C ~ $+70^{\circ}\text{C}$
- NXA can resist the following electromagnetic interference
 - Overvoltage generated by electromagnetic interference
 - Overvoltage caused by environment interference or a power distributing system
 - Electrostatic discharge of radio waves (radio, intercom, radar and the like)
- NXA has successfully passed the test for electromagnetic compatibility specified according to the following standards (EMC) IEC/EN 60947-2 Annex F
The test can guarantee no false tripping and no interference on tripping time
- Protection grade:
Front IP 20, other side IP 00

Connection

- Rear connection
Horizontal connection, vertical connection
- Optional accessories
Interphase barrier


Lock

- Padlocks of "Making" and "Breaking" push button
- Position padlock (for locking the circuit breaker at disconnected position)
- Chassis padlock
- Door interlock: the circuit breaker is arranged at the connected or test part so as to prohibit to open the door

Indication contact

- Standard contact
Making and breaking indication contacts
Fault tripping indication contact
- Optional accessories
Position indication contact
Spring charged indication contact

Drawout type breaker



Drawer seat



Body



Drawout type breaker

Fixed type breaker




NXA16



NXA20 ~ NXA40

Note: NXA63 fixed type is seen in P45

Accessories



Interphased partition



Secondary wiring terminal-drawout type



Secondary wiring terminal-fixed type



N pole CT



Counter





PSU-1

Product selection

NXA series air circuit breaker

Frame size	Rated current Breaking capacity	400	630	800	1000	1250	1600	2000	2500	3200	3600	4000	5000	6300
1600A	N	■	■	■	■	■	■							
	S	■	■	■	■	■	■							
	H	■	■	■	■	■	■							
2000A	N		■	■	■	■	■	■						
	S		■	■	■	■	■	■						
	H		■	■	■	■	■	■						
3200A	N						■	■	■	■				
	S						■	■	■	■				
	H						■	■	■	■				
4000A	N									■	■	■		
	S									■	■	■		
	H									■	■	■		
6300A	H											■	■	■

Model definition and description

NXA	16	N	04	M		D	3	AC230	M	Other
Code of Product	Code of frame size	Code of breaking capacity	Code of rated current	Code of intelligent controller		Code of installation method	Code of number of poles	Code of control circuit voltage	Code of operation mode	Code of special requirement
	16:1600A (04-16)	N: basic type	04-400A 06-630A 08-800A	M: basic type		D: draw-out type	3: 3 poles	AC 230: AC 230V	No code: motor operation	No code: no special requirement
	20:2000A (06-20)	S: standard type	10-1000A 12-1250A	A: current type						
	32:3200A (16-32)	H: advanced type	16-1600A 20-2000A	P: power type		F: fixed type	4: 4 poles	AC 400: AC 400V	M: manual operation	Special requirements code, such as: UVT
	40:4000A (32-40)		25-2500A 32-3200A	H: harmonic type				DC 110: DC 110V		
	63:6300A (40-63)		36-3600A 40-4000A	PT: power + temperature type				DC 220: DC 220V		
			50-5000A 63-6300A	HT: harmonic + temperature type						

Note: ¹⁾ Intelligent controller PT/HT type. The basic functions are the same with P/H type. T refers to the internal temperature measurement function.

²⁾ Manual operation does not contain motor-driven mechanism, closing electromagnet and shunt release. Motor operation contains all standard accessories of remote operation.

³⁾ Auxiliary working voltage of the intelligent controller: corresponding power modules is required if DC220V or DC110V is selected.

⁴⁾ NXA16N10-AD3-AC230: frame size is 1600A, N type breaking capacity, rated current is 1000A, A type intelligent controller, draw-out type and 3 poles, control voltage is AC 230V motor operation.


Model definition and description-intelligent controller

NXA	16	TU	M	04	3	AC230
Code of product	Code of frame size	Intelligent controller	Code of intelligent controller	Code of rated current	Code of number of poles	Code of auxiliary power supply
	16:1600A (04-16)		M: basic type	04-400A; 06-630A	3: 3 poles	AC 230: AC 230V
	20:2000A (06-20)		A: current type	08-800A; 10-1000A	4: 4 poles	AC 400: AC 400V
	32:3200A (16-32)		P: power type	12-1250A; 16-1600A		DC 110: DC 110V
	40:4000A (32-40)		H: harmonic type	20-2000A; 25-2500A		DC 220: DC 220V
	63:6300A (40-63)		PT: power+ temperature type	32-3200A; 36-3600A		
			HT: harmonic + temperature type	40-4000A; 50-5000A		
				63-6300A		

Model definition and description-accessories

NXA	16	CC	230VAC
Code of product	Frame size	Code of accessories	Code of rated voltage
	16:1600A	CC: Closed electromagnet	230VAC: AC230V
	20:2000A	ST: Shunt tripper	400VAC: AC400V
	32:3200A	MO: Motor	110VDC: DC110V
	40:4000A	UVT: Undervoltage tripper	220VDC: DC220V
	63:6300A	ASUVT:Self-priming undervoltage tripper	Rated voltage+delay time (1s, 3s, 5s, 7s)
	20/40:2000A-4000A	UVTD:UVT delay unit	
	20/32:2000A-3200A	ASUVD: ASUVT delay unit	
	20/63:2000A-6300A		

Product selection

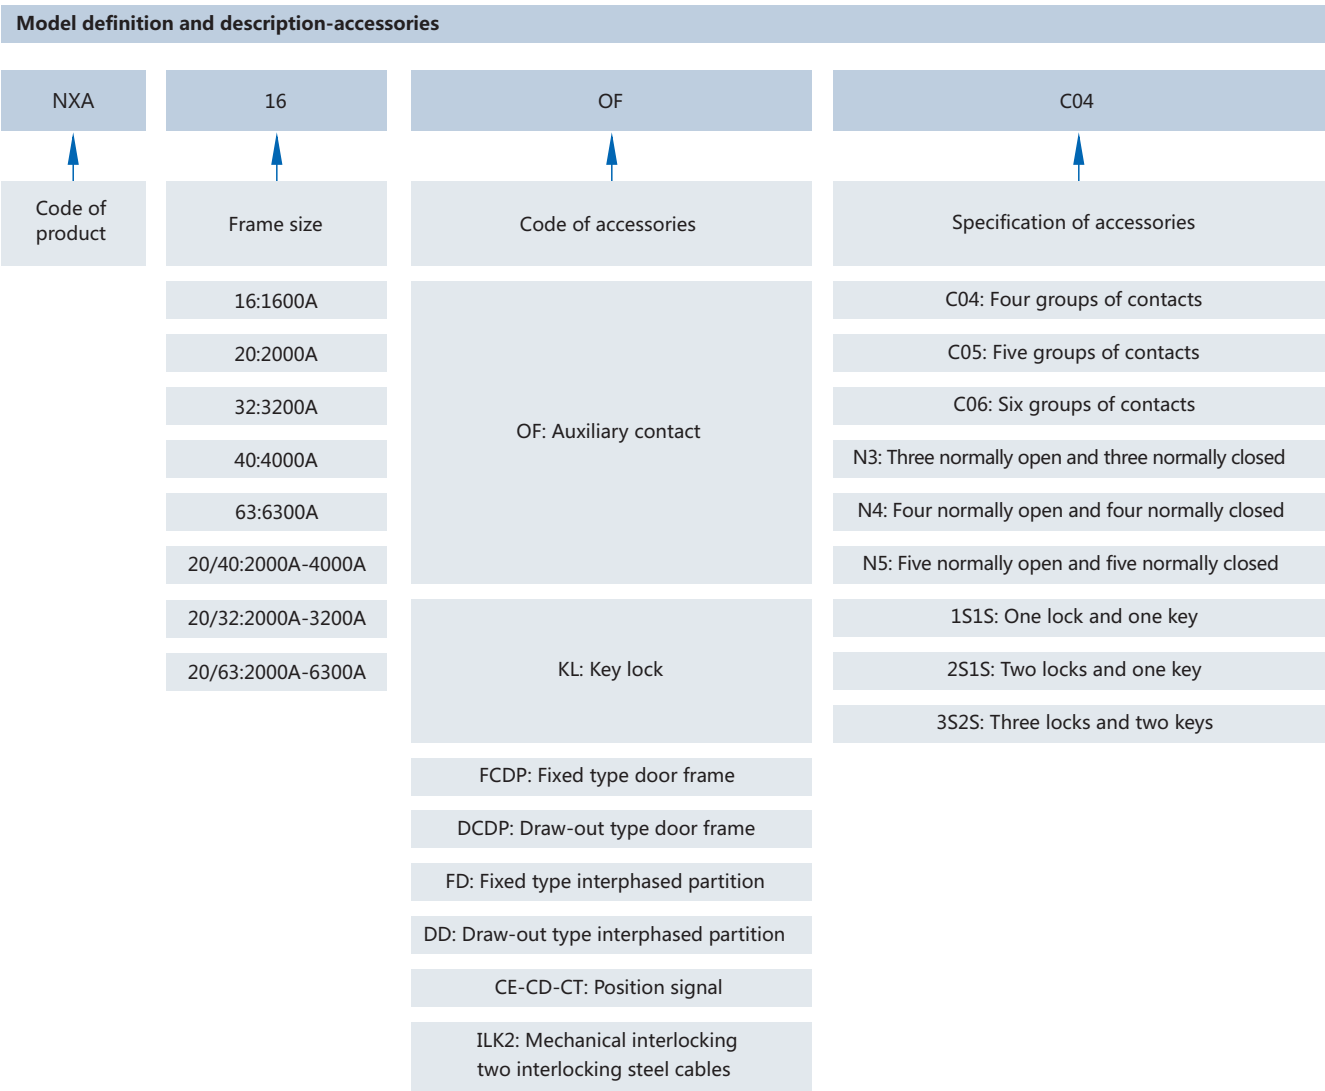

Note

[illegible]

Functions and features

Technical parameters

Features		
Number of poles	3/4 6300A only 3P	
Rated operational voltage Ue (V)	380/400/415 , 440/525/690V	
Rated insulation voltage Ui (V)	1000	
Rated impulse withstand voltage Uimp (kV)	12	
Rated frequency (Hz)	50/60	
Flashover distance (mm)	0	
Applicable to isolation	IEC/EN 60947-2	Applicable
Pollution grade	IEC 60664-1	N:3

Frame size			1600A					
Rated current (A)			400	630	800	1000	1250	1600
Rated current of the fourth pole (A)			400	630	800	1000	1250	1600
Type of the circuit breaker			N	S	H			
Rated ultimate short circuit breaking capacity (kA rms) VAC 50/60Hz	Icu	380/400/415V	50	42	50			
		440/525/690V	30	36	36			
Rated service short circuit breaking capacity (kA rms) VAC 50/60Hz	Ics	380/400/415V	42	42	50			
		440/525/690V	30	36	36			
Utilization category			B					
Rated short-time withstand current (kA rms) VAC 50/60Hz	Icw 1s	380/400/415V	42	42	42			
		440/525/690V	30	36	36			
	Icw 3s	380/400/415V	20	25	25			
		440/525/690V	-	-	-			
Closed capacity (kA peak) VAC 50/60Hz	Icm	380/400/415V	105	88.2	105			
		440/525/690V	63	75.6	75.6			
Making current tripping protection function (MCR kA rms)			10	16	16			
Breaking time (ms)			32					
Closing time (ms)			70					
Installation, connection and service life								
Service life C/O cycle	Mechanical	Without maintenance	15000					
	Electrical	Without maintenance	8000					
Connection	Horizontal		■					
Size (width × depth × height)	Fixed type	3P	254×243.5×318.5					
		4P	324×243.5×318.5					
	Draw-out type	3P	308×331.5×351					
		4P	378×331.5×351					

	2000A						3200A				4000A			6300A			
	630	800	1000	1250	1600	2000	1600	2000	2500	3200	3200	3600	4000	4000	5000	6000	
	630	800	1000	1250	1600	2000	1600	2000	2500	3200	3200	3600	4000	2000	2500	-	
	N	S	H				N	S	H				N	S	H	H	
	80	65	80				80	80	100				80	85	100	120	
	50	55	55				65	70	70				65	75	75	85	
	50	65	65				80	80	85				80	85	85	120	
	50	55	55				65	70	70				65	75	75	85	
	B						B				B				B		
	50	65	65				65	80	85				65	85	85	100	
	50	55	55				65	70	70				65	75	75	75	
	37	42	42				37	50	50				37	50	50	-	
	-	-	-				-	-	-				-	-	-	-	
	176	143	176				176	176	220				176	187	220	264	
	105	121	121				143	154	154				143	165	165	187	
	16	16	16				26	26	26				26	26	26	26	
	32						32				32				32		
	70						70				70				70		
	15000						10000				10000			2000			
	8000						7000				3000			500			
	■						■				■			■			
	374×344×400						439×373.5×400				550×337.5×400			897×435.5×399			
	469×344×400						554×373.5×400				700×337.5×400			897×435.5×399			
	403×430×438.5						463×499.5×438.5				569×416×438.5			923×500×435.5			
	498×430×438.5						578×499.5×438.5				719×416×438.5			923×500×435.5			

Functions and features


Intelligent controller

M type intelligent controller (Basic type)


Protection

All the protective threshold and time delay are set by a dial switch

- Overload protection
 - True RMS long-time-delay protection
 - Thermal memory: heat accumulation before and after tripping
- Short circuit protection
 - Short-time delay (RMS) and instantaneous protection
 - Optional four steps time-delay setting
- Earth fault protection
 - Optional four steps time-delay setting
- Neutral line overcurrent protection (4P)
 - The neutral protective threshold can be adjusted to 50%, 100% and OFF
- Test function
 - Simulating 6Ir test current for test tripping
- Tripping record function
- Ampere meter
 - Measure the real and effective value (RMS) of current with the precision of 2% for 40% to 150% in setting

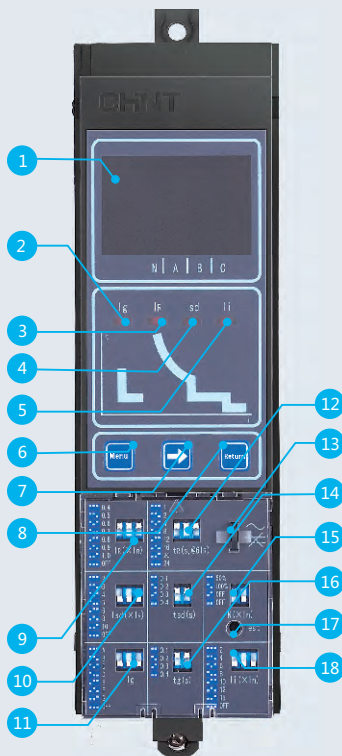

1. Display window: display the current value, the setting parameter, the fault current, the tripping time
2. Ig indicator for earth fault indication
3. Ir indicator for overload long-time-delay tripping
4. Isd indicator for short circuit short-time-delay tripping
5. Ii indicator for short circuit tripping
6. Menu button for inquiring the dial position and fault record
7. Rightward button: turn to the next state when inquiring the dial position
8. Return button: back to the previous level or resetting
9. Overload long-time-delay current setting
10. Short circuit short-time-delay current setting
11. Earth fault current setting
12. Overload long-time-delay time setting
13. Transparent cover lockhole
14. Short circuit short-time-delay time setting
15. Neutral line protection setting
16. Earth fault time-delay setting
17. Test button for simulating 6IR current
18. Short circuit instantaneous current setting

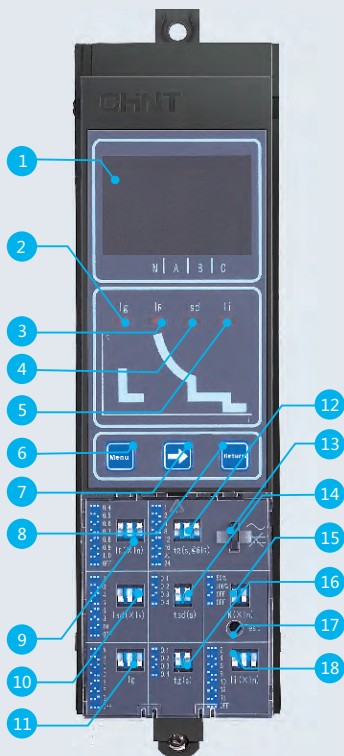

1. Display window: display the current value, the setting parameter, the fault current, the tripping time
2. Ig indicator for earth fault indication
3. Ir indicator for overload long-time-delay tripping
4. Isd indicator for short circuit short-time-delay tripping
5. Ii indicator for short circuit tripping
6. Menu button for inquiring the dial position and fault record
7. Rightward button: turn to the next state when inquiring the dial position
8. Return button: back to the previous level or resetting
9. Overload long-time-delay current setting
10. Short circuit short-time-delay current setting
11. Earth fault current setting
12. Overload long-time-delay time setting
13. Transparent cover lockhole
14. Short circuit short-time-delay time setting
15. Neutral line protection setting
16. Earth fault time-delay setting
17. Test button for simulating 6IR current
18. Short circuit instantaneous current setting


A type intelligent controller (Current type)

Protection

All the protective threshold and time delay are set by a dial switch

- Overload protection
 - True RMS long-time-delay protection
 - Thermal memory: heat accumulation before and after tripping
- Short circuit protection
 - Short-time delay (RMS) and instantaneous protection
 - Optional four steps time-delay setting
- Earth fault protection
 - Optional four steps time-delay setting
- Neutral line overcurrent protection (4P)
 - The neutral protective threshold can be adjusted to 50%, 100% and OFF
- Unbalanced current protection
 - Protecting phase failure or three phase unbalance
- Test function
 - Simulating 6Ir test current for test tripping
- Tripping record function
- Ampere meter
 - Measure the real and effective value (RMS) of current with the precision of 2% for 40% to 150% in setting

Functions and features

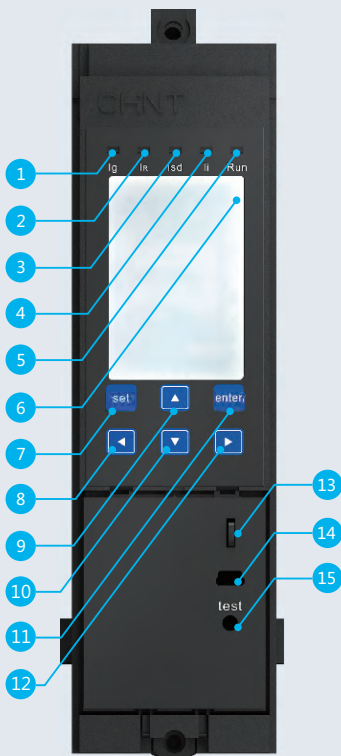

1. Ig indicator for earth fault tripping
2. Ir indicator for overload long-time-delay tripping
3. Isd indicator for short circuit short-time-delay tripping
4. Ii indicator for short circuit tripping
5. Running indicator flickering in normal running
6. LCD screen with three-color backlight.
Green stands for normal running, yellow stands for alarming and red stands for tripping.
7. Setting button
8. Leftward button
9. Upward button
10. Downward button
11. Enter button
12. Rightward button
13. Transparent cover lockhole
14. Mini-USB interface
15. Test button for tripping test

P type intelligent controller (Power type)

Protection

Setting all protective threshold values and time-delay by button


The setting values can be displayed on LCD display window

- Protection functions of all A type control units are included
- Earth current protection function (Optional)
External transformer are configured
- Advanced protection function
 - Unbalanced voltage protection
 - Overvoltage and undervoltage protection
 - Overfrequency and underfrequency protection
 - Phase sequence protection
 - Reverse power protection function
 - Required value protection function

The required value of the real and effective value of each current is calculated within a measurement window. When the required value is off limit, the protection action is carried out. The setting of a sliding time window is in the menu of "setting of a measurement meter".

- A-phase maximal required current value,
- B-phase maximal required current value,
- C-phase maximal required current value,
- N-phase maximal required current value are respectively set for each circumstance of the required value protection without being affected by the setting of the neutral line protection.

- Extended function
 - Self-diagnosis by the intelligent controller
 - Operation times/fault tripping/alarming/deflection recording function provides the latest ten times of recording
 - Main contact abrasion display function for evaluating the contact abrasion degree according to mechanical life, electrical services and breaking capacities of different frames.
 - Internal clock function
 - A Mini-USB interface is connected with a PC to achieve the functions of protection setting, fault record downloading, whole power quantity detection and parameter reading of a circuit breaker.
 - "test" push button
- Electric energy meter
 - Current measurement
 - Voltage measurement
 - Frequency measurement
 - Required value measurement
 - Power (active power, reactive power and apparent) measurement
 - Electric energy (active power, reactive power and apparent) measurement
 - Power factor measurement
- Busbar temperature measurement (Optional)
The temperature of the busbar is measured by a temperature transformer in the busbar, and can be display on a LCD screen in real time. Customers can set the temperature threshold value and set the alarm.
- LCD three-color backlight
Green stands for normal running, yellow stands for alarming and red stands for tripping.

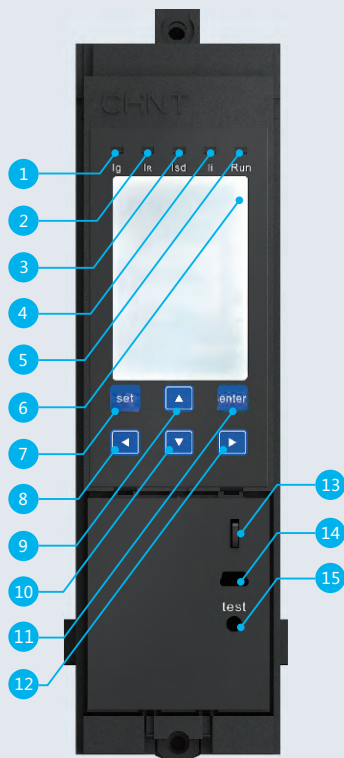

1. Ig indicator for earth fault tripping
2. Ir indicator for overload long-time-delay tripping
3. Isd indicator for short circuit short-time-delay tripping
4. Ii indicator for short circuit tripping
5. Running indicator flickering in normal running
6. LCD screen with three-color backlight.
Green stands for normal running, yellow stands for alarming and red stands for tripping.
7. Setting button
8. Leftward button
9. Upward button
10. Downward button
11. Enter button
12. Rightward button
13. Transparent cover lockhole
14. Mini-USB interface
15. Test button for tripping test

H type intelligent controller (Harmonic wave type)

Protection

Setting all protective threshold values and time-delay by button

Besides the protective extended function of all P type control units,

H type control unit also comprises:

- Load monitoring function
- Zone selective interlock (ZSI) (Optional)
- Communication function
Modbus-RTU communication protocol
- Input/output function
 - 2DI+2DO or 4DO
 - DI signal: AC230V (Standard configuration, and others can be selected);
DC110V
 - DO needs to be configured with a power supply module (24VDC output) and a relay module.
- Harmonic analysis function
 - Measurement of the fundamental wave current, the fundamental wave line voltage, the fundamental wave phase voltage, the fundamental wave power and each 3-31 odd harmonic wave current percentage (HRIh), the harmonic voltage percentage (HRUh), the total harmonic wave current distortion rate (THDi, thdi) and the total harmonic wave voltage distortion rate (THDu, thdu).
 - The harmonic wave percentage(HR) refers to the ratio of root-mean-square value of the Nth harmonic wave component contained in periodic alternative current quantity to the root-mean-square value of the fundamental wave component, and is expressed in percentage.

Functions and features

Protection features

The protection features of the intelligent controller comprise inverse time characteristic and constant time characteristic. When the fault current exceeds the set value of the inverse time limit, the controller performs constant time protection.

The inverse time limit corresponds to the feature curve I^2t .

Overload long-time-delay protection feature

Overload long-time-delay protection action threshold value

$<1.05I_r$: $>2h$, no action

$\geq 1.3I_r$: $<1h$, action

I_r current setting value range: $0.4I_n$, $0.5I_n$, $0.6I_n$, $0.7I_n$, $0.8I_n$, $0.9I_n$, $1.0I_n$ +OFF (M/A); $0.4I_n \sim 1.0I_n$ +OFF(P/H)

Inverse time limit action feature: I^2t , wherein $t=(6/N)^2 \times t_r$

Setting Multiple of Current	Action Time							
$1.5I_r$	16	32	64	128	192	256	320	384
$2I_r$	9	18	36	72	108	144	180	216
$6I_r$	1	2	4	8	12	16	20	24

Note: N --- the multiple I/I_r obtained by dividing failure current by set current

t --- time delay action of the failure action

t_r --- long-time-delay set value

Allowed error of the action time $\pm 15\%$

Conventional factory tuning: $I_r=1.0I_n$

$t_r=2s@6I_r$

Short circuit short-time-delay protection feature

Short circuit short-time-delay protection action threshold value

$<0.85I_{sd}$: no action

$>1.15I_{sd}$: action

I_{sd} current set value range: $2I_r$, $3I_r$, $4I_r$, $5I_r$, $6I_r$, $8I_r$, $10I_r$ +OFF (max 50kA, M/A); $2I_r \sim 10I_r$ +OFF(max 50kA, P/H)

Current	Action time		Remark
$I_{sd} < I \leq 10I_r$	Inverse time limit	Action feature $I^2t = (10I_r)^2 t_{sd}$	P, H
		Setting time s 0.1, 0.2, 0.3, 0.4	
$I \geq 1.1I_{sd}$	Constant time limit	Setting time s 0.1, 0.2, 0.3, 0.4	M, A, P, H
		Minimum s 0.06, 0.16, 0.255, 0.34	
		Maximum s 0.14, 0.24, 0.345, 0.46	
	Return time	0.05, 0.14, 0.25, 0.33	

Note: I_{sd} ---short-time-delay current set value

I--- failure current value

I_r --- long-time-delay set value

t--- failure action time-delay time

t_{sd} ---short-time-delay inverse time limit set value

Permissible error of action time $\pm 15\%$

Conventional factory tuning: $I_{sd}=8I_r$ ($I_r < 6250A$)

$I_{sd}=50kA$ ($I_r \geq 6250A$)

$t_{sd}=0.4s$

Short circuit instantaneous protection features

Short circuit instantaneous protection action threshold value

<0.85I_i: no action

>1.15I_i: action

The current setting value of instantaneous action: 2I_n, 4I_n, 6I_n, 8I_n, 10I_n, 12I_n, 15I_n+OFF(NXA40 max50kA , NXA63 max63kA , M/A);

2I_n~15I_n+OFF(NXA40 max 50kA , NXA63 max63kA P/H)

Note: action time≤50ms

Conventional factory tuning:I_i=12I_n(I_n=400A~5000A)

I_i=63kA(I_n=6300A)

Earth fault protection action features

Earth fault protection action threshold value

<0.9I_g: no action

>1.1I_g: action

M/A

Current setting value	A	B	C	D	E	F	G	OFF
NXA16, 20	0.2I _n	0.3I _n	0.4I _n	0.5I _n	0.6I _n	0.8I _n	I _n	
NXA32, 40, 63	500A	640A	800A	960A	1040A	1120A	1200A	
tg(s)	Inverse time limit	Action features						

P/H

NXA16, 20: 0.2I_n~1.0I_n+OFF

NXA32, 40, 63: 500A~1200A+OFF

$$t = \frac{(I_g)^2}{I^2} \times t_g$$

Constant time limit	Setting time (s)	0.1	0.2	0.3	0.4
	Minimum (s)	0.06	0.16	0.255	0.34
	Maximal (s)	0.14	0.24	0.345	0.46
	Return time	0.05	0.14	0.25	0.33

Note: I_g --- earth fault protection setting value. Default setting:NXA16/20:I_g=0.5I_n

When I_n≥1250A , I_g max=1200A

NXA32/40/63: I_g=800A

I --- failure current value

t --- failure action time-delay time

tg --- earthing inverse time limit set value

The permissible error of the inverse time limit action time: ±15%

Conventional factory tuning:OFF

Controller minimum display current

Frame	I _n	Minimum display value (A)
1600	400 ~ 1600	60
2000	630 ~ 2000	60
≥3200	≥1600	120

Functions and features

Measurement precision of the intelligent controller

Current measurement	
Measurement range	Ia, Ib, Ic and I _e are not less than 15In (rated current of the circuit breaker)
Measurement precision	Below 0.1In: the measurement is inaccurate
	0.1In-0.4In: the accuracy will be changed linearly from 5% to 2%
	0.4In-1.5In: the accuracy is 2%
	>1.5In: the accuracy will be changed linearly from 2% to 15%
	The measurement accuracy of the earthing current is 10%
Voltage measurement	
Measurement range	Line voltage: 0V~600V
	Phase voltage: 0V~300V
Measurement precision	Error: ±1%
Frequency	
Measurement range	40HZ~70HZ
Measurement precision	Error: ± 0.1HZ
Power	
Measurement mode	The effective value mode
Measurement content	3P type: total active power, total reactive power and total apparent power
	4P type: phase splitting active power, phase splitting reactive power, phase splitting apparent power, total active power, total reactive power, total apparent power
Measurement power	Active power: -32768KW~ + 32767KW
	Reactive power: -32768Kvar~ + 32767Kvar
	Apparent power: 0KVA~65535KVA
	Error: ±2.5%
Power factor	
Measurement content	phase splitting power factor , total power factor
Measurement range	-1.00~+1.00
Electric energy	
Measurement content	Input reactive electric energy (EQin), output reactive electric energy (Eqout)
	Input active electric energy (EPin), output active electric energy (Epout)
	Total active electric energy (EPtotal), total reactive electric energy (EQtotal), total apparent electric energy (Estotal)
Measurement range	Active electric energy: -32768KWh~ + 32767KWh
	Reactive electric energy: -32768Kvarh~ + 32767Kvarh
	Apparent electric energy: 0~65535KVAh
Measurement precision	Error ±2.5%
Harmonic wave measurement	
Fundamental wave measurement	Current: Ia, Ib, Ic, I _e
	Voltage: Uan, Ubn, Ucn
Total harmonic wave distortion THDu and thdu	THD: the total distortion rate of the harmonic wave relatively to the fundamental wave
	Thd: the total distortion rate of the harmonic wave relatively to the effective value
Amplitude wave spectrum of harmonic wave	The controller can display FFT amplitude of odd harmonic wave from 3 to 31in percentage
Measurement precision of control unit	±2%

LSI curves

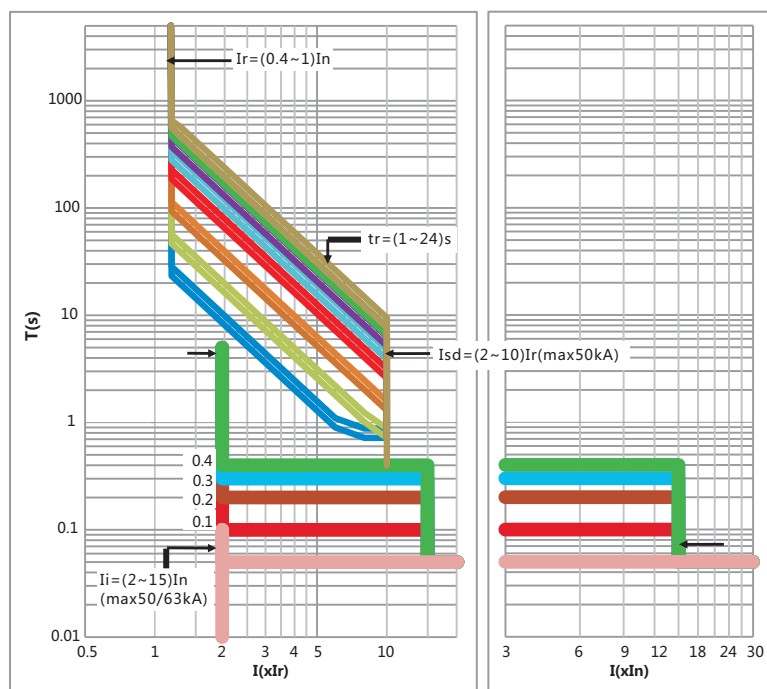


Fig.1 Overcurrent protection curves

Earth fault protection curves

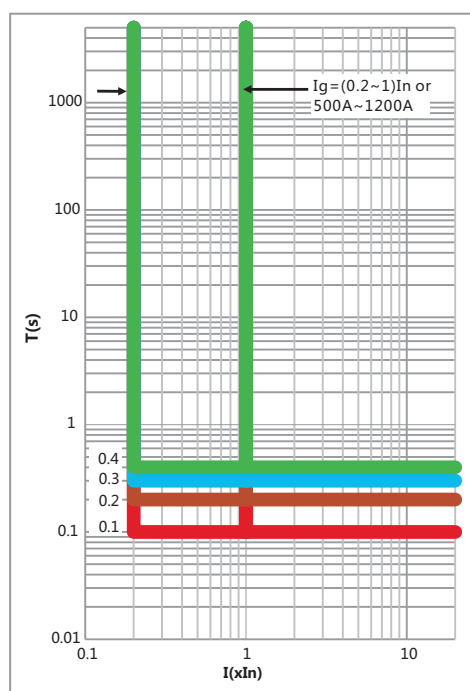


Fig.2 Asymmetrical earth fault protection curves

Functions and features



Accessories: locks

Pushbutton lock

The pushbutton lock is to lock the circuit breaker by a transparent cover blocks so as to prevent the breaking button and the making button of the circuit breaker from misoperation and guarantee the reliable running of the circuit breaker.

Body lock

- A key lock includes four types. The latter two are applied to 2 input and 1 connect power distribution system:
 - Random lock
 - One lock and one key
 - Two locks and one key
 - Three locks and two keys

Note : When the user separately purchases the key lock for installation, the panel needs to be opened with a hole opener, and the hole opener is provided by the user.

Hole diameter : NXA16:Φ21mm NXA20~63:Φ24mm

Safety shutters padlock

- The padlock is prepared by users. Diameter of the lock is no more than Φ5mm. when a circuit breaker body is at the disconnected or test part, the safety shutters automatically block access to the disconnecting contact cluster.

"Disconnected" position padlock

After the chassis and body are locked at "Disconnected" position by a padlock, the racking-handle cannot be inserted into racking-handle entry, and then the position of the body cannot be changed.

Door interlock

- Circuit breaker state door interlock
A cabinet door is prohibited to be opened when the circuit breaker is closed.
The cabinet door is allowed to be opened when the circuit breaker is disconnected.
- Circuit breaker position door interlock
The cabinet door is prohibited to be opened when the circuit breaker is at the connected and test part. The cabinet door is allowed to be opened when the circuit breaker is at the disconnected position.

Cable mechanical interlock


It can realize the interlock of two horizontal or vertical-installed, three poles or four poles, drawout type or fixed type circuit breaker.

Circuit diagram	Available running manner	
	1QF	2QF
	0	0
	0	1
	1	0

- Note:
- If need bend the cable, make sure radian is more than 120°.
 - Check and make sure enough lubricating oil of the cable.
 - The maximum distance between two interlock circuit breakers is 1.5m.

Operation pushbutton lock (Optional)

Used for locking the break pushbutton and the close pushbutton (Padlock is prepared by users).

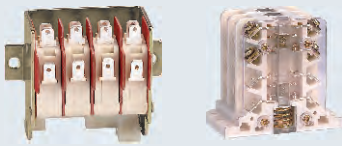

Accessories: indication contacts

ON/OFF indication contacts			
Standard configuration		4CO	6CO(NXA16)
Breaking capacity		Current (A) / Voltage (V)	
Utilization category	VAC(AC-15)	1.3/240, 0.75/415	1.3/240, 0.75/415
	VDC(DC-13)	0.55/110, 0.27/220	0.55/110, 0.27/220

"Connected", "disconnected" and "test" position indication contact			
Standard configuration		1CO/3	
Breaking capacity		Current (A) / Voltage (V)	
Utilization category	VAC(AC-15)	1.3/240, 0.75/415	
	VDC(DC-13)	0.55/110, 0.27/220	

Alarming contact			
Standard configuration		1CO	
Breaking capacity		Current (A) / Voltage (V)	
Utilization category	VAC(AC-15)	1.3/240, 0.75/415	
	VDC(DC-13)	0.55/110, 0.27/220	

Spring charging indication contact			
Standard configuration		1NO	
Breaking capacity		Current (A)/ Voltage (V)	
Utilization category	VAC(AC-15)	1.3/240, 0.75/415	
	VDC(DC-13)	0.55/110, 0.27/220	

Note: ¹⁾ CO refers to a switch contact, and a one-normally-open and one-normally-closed contact is matched with a common terminal.

²⁾ NO refers to a normally open contact. NC refers to a normally closed contact.

Source-changeover systems

- Mechanical interlock
 - 1 normal and 1 replacement
 - 2 incoming and 1 busbar
- Source-changeover controller (with adaptor)
 - 1 normal and 1 replacement: mechanical interlock+2A type controller
 - 2 incoming and 1 busbar: mechanical interlock+3A type controller

Functions and features



1600A frame MO



2000A~6300A frame MO



1600A frame CC&ST



2000A~6300A frame CC&ST

● Motor-driven mechanism (MO) (Standard configuration)

When a circuit breaker is switched on, an motor operation mechanism stores energy automatically, so that when the circuit breaker is tripped, the device can switch on instantly. An energy-storage handle as spare when no auxiliary power supply is provided.

Characteristics		
Power supply	VAC 50/60HZ	220/230/240, 380/400/415
	VDC	110, 220
Operation threshold		0.85-1.1Us
Frame size: power loss (VA or W)		16: 75W; 20: 85W; 32: 110W; 40: 110W; 63: 150W
Motor overcurrent		≤1min
Charging time		≤7s
Operation frequency		≤2times/min

● Voltage coils (CC &ST) (Standard configuration)

● Closing coil (CC)

The CC closing coil remotely closes the circuit breaker if the spring mechanism is charged.

● Shunt release (ST)

The ST release instantaneously opens the circuit breaker when energised.

Characteristics		CC	ST
Power supply	VAC 50/60HZ	220/230/240 380/400/415	220/230/240 380/400/415
	VDC	220, 110	220, 110
Operational voltage		0.85-1.1Us	0.7-1.1Us
Frame size: power loss (VA or W)	AC	16: 400VA; 20~63: 400VA	16: 400VA; 20~63: 400VA
	DC	16: 380W; 20~63: 130W	16: 380W; 20~63: 130W
Circuit breaker response time at Un		40ms-60ms	30ms-50ms



1600A frame UVT



2000~4000A frame UVT



6300A frame ASUVT



2000~4000A frame UVTD

● Undervoltage release (UVT)

When the power supply voltage drops to be a value between 35%-70%, the release coil causes the circuit breaker to trip instantly. If there is no supply on the release, it is impossible to close the circuit breaker, either manually or electrically. Circuit breaker closing is enabled again when the supply voltage of the release returns to 85% of its rated value.

Characteristics			
Power supply	VAC 50/60HZ	220/230/240, 380/400/415	
	VDC	-	
Operation threshold	Open	0.35-0.7Ue	0.35-0.7Ue
	Closed	0.85Ue	0.85-1.1Ue
Frame size: power loss (W)			16: 220W/15W; 20~40: 220W/13W; 63: 90W/25W

Note: actuation/maintaining.

● UVT delay unit (UVTD)

To eliminate the false tripping caused by short-time voltage drop, UVT action time delay is required. The function is realized by additionally increasing a time delay unit for UVT (Except the NXA16 and NXA63).

Characteristics			
Power supply	VAC 50/60HZ		
Operation threshold	Open	0.35-0.7Ue	
	Closed	0.85Ue	
Frame size: power loss (VA)		16: 20VA; 20~40: 48VA	
Adjustable time		16:1s, 3s, 5s, 7s; 20~40 : 1s, 3s, 5s; 63:0.3s, 0.5s, 0.7s, 1s, 2s, 3s, 5s, 7s	

Functions and features

Capacity derating and power loss

Temperature capacity derating table of the fixed type circuit breaker

1600A frame

Ambient temperature	400A		630A		800A		1000A		1250A		1600A	
Connection mode	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical
40°	–	–	–	–	–	–	–	–	–	–	–	–
45°	–	–	–	–	–	–	–	–	–	–	–	–
50°	–	–	–	–	–	–	–	–	–	–	1550	1600
55°	–	–	–	–	–	–	–	–	1150	1200	1500	1550
60°	–	–	550	580	–	–	–	–	1050	1100	1450	1500

2000A frame

Ambient temperature	630A		800A		1000A		1250A		1600A		2000A	
Connection mode	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical
40°	–	–	–	–	–	–	–	–	–	–	–	–
45°	–	–	–	–	–	–	–	–	1550	–	1900	–
50°	–	–	–	–	–	–	–	–	1500	1550	1850	1900
55°	–	–	–	–	–	–	–	–	1400	1450	1800	1800
60°	–	–	–	–	–	–	–	–	1300	1350	1700	1700

3200A frame

Ambient temperature	1600A		2000A		2500A		3200A	
Connection mode	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical
40°	–	–	–	–	–	–	–	–
45°	–	–	–	–	–	–	–	–
50°	–	–	–	–	–	–	3100	–
55°	–	–	–	–	2450	–	3000	3050
60°	–	–	–	–	2350	2400	2900	2950

4000A frame

Ambient temperature	3200A		3600A		4000A	
Connection mode	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical
40°	–	–	–	–	–	–
45°	3100	–	–	–	3800	3850
50°	3000	–	–	–	3600	3650
55°	3000	3050	3400	3450	3400	3450
60°	2900	2900	3200	3250	3200	3250

6300A frame

Ambient temperature	4000A		5000A		6300A	
Connection mode	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical
40°	–	–	–	–	–	–
45°	–	–	–	–	–	–
50°	–	–	–	–	5600	5650
55°	–	–	4800	4850	5400	5450
60°	–	–	4800	4850	5200	5250

Note: "–" refers to no capacity derating.

Temperature capacity derating table of the draw-out type circuit breaker

1600A frame

Ambient temperature	400A		630A		800A		1000A		1250A		1600A	
Connection mode	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical
40°	–	–	–	–	–	–	–	–	–	–	–	–
45°	–	–	–	–	–	–	–	–	–	–	1550	–
50°	–	–	–	–	–	–	–	–	1150	1200	1500	1550
55°	–	–	550	580	–	–	–	–	1050	1100	1450	1500
60°	–	–	500	530	–	–	950	–	950	1000	1400	1450

2000A frame

Ambient temperature	630A		800A		1000A		1250A		1600A		2000A	
Connection mode	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical
40°	–	–	–	–	–	–	–	–	–	–	–	–
45°	–	–	–	–	–	–	–	–	1500	–	1850	1900
50°	–	–	–	–	–	–	–	–	1400	1500	1750	1850
55°	–	–	–	–	–	–	–	–	1300	1400	1650	1750
60°	600	–	–	–	–	–	1200	–	1200	1300	1550	1650

3200A frame

Ambient temperature	1600A		2000A		2500A		3200A	
Connection mode	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical
40°	–	–	–	–	–	–	–	–
45°	–	–	–	–	2450	–	3100	–
50°	–	–	–	–	2400	2450	3000	3100
55°	–	–	–	–	2350	2400	2900	3000
60°	–	–	–	–	2300	2350	2800	2900

4000A frame

Ambient temperature	3200A		3600A		4000A	
Connection mode	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical
40°	–	–	–	–	–	–
45°	3100	–	–	–	3800	3850
50°	3000	3100	–	–	3600	3650
55°	2900	3000	3400	3450	3400	3450
60°	2800	2900	3200	3250	3200	3250

6300A frame

Ambient temperature	4000A		5000A		6300A	
Connection mode	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical
40°	–	–	–	–	–	–
45°	–	–	–	–	–	–
50°	–	–	–	–	5600	5650
55°	–	–	4800	4850	5400	5450
60°	–	–	4800	4850	5200	5250

Note: "–" refers to no capacity derating.

Functions and features

Altitude capacity derating factor

Altitude height (m)		2000	3000	4000	5000
Rated impulse withstand voltage (kV)	Uimp	12	10	8.57	7.5
Average insulation grade (V)	Ui	1000	833	714	625
Maximal operational voltage (V) 50/60Hz	Ue	690	580	500	415
Average heat operational current(40)°C		1.0	0.88	0.78	contact with factory

Power loss and input and output resistance

Power loss is the power loss of each pole measured at In, 50/60Hz. The input/output resistance is the DC resistance value of each pole at the cold state.

Frame size	Rated current (A)	Draw-out type		Fixed type (W)	
		Power loss (W)	Input/output resistance (μohm)	Power loss (W)	Input/output resistance (μohm)
1600A	400	30.5	63.6	15.6	32.4
	630	75.7	63.6	38.6	32.4
	800	99.1	51.6	54.1	28.2
	1000	154.8	51.6	84.6	28.2
	1250	241.9	51.6	132.2	28.2
	1600	262.7	34.2	138.2	18.0
2000A	630	58.6	49.2	26.4	22.2
	800	73.7	38.4	36.6	19.1
	1000	115.2	38.4	57.2	19.1
	1250	180	38.4	89.4	19.1
	1600	294.9	38.4	146.5	19.1
	2000	388.8	32.4	204.5	17.0
3200A	1600	127.2	16.6	60.1	7.8
	2000	198.7	16.6	93.9	7.8
	2500	310.5	16.6	146.7	7.8
	3200	479.2	15.6	206.4	6.8
4000A	3200	435	14.1	239.6	7.8
	3600	690.5	17.7	272.9	7.0
	4000	852.5	17.7	337	7.0
6300A	4000	403.2	9.0	230.4	7.0
	5000	630	9.0	360	7.0
	6300	1000.2	8.8	571	6.4

Dimension of busbar

Bolt configuration

Type of bolt	Application	Fastening busbar
16: M10	Fastening busbar	(49~59)N·m
20~63: M12	Fastening busbar	(86~103)N·m
16~63 : M3	Fastening secondary connector	(0.5~0.7)N·m

Hole size and installation twisting moment of busbar

Drilling Φ (mm)	Diameter of bolt	Fastening twisting moment
16: Φ 11	M10	(49~59)N·m
20~63: Φ 13	M12	(86~103)N·m

Connection busbar specification reference under different temperature

Maximum permissible temperature of busbar: 100°C

The material of busbar is bare copper

Frame size	Rated current (A)	Ambient temperature(-5~40)°C				Ambient temperature 50°C				Ambient temperature 60°C			
		5mm thick busbar		10mm thick busbar		5mm thick busbar		10mm thick busbar		5mm thick busbar		10mm thick busbar	
		Number of pieces	Specification	Number of pieces	Specification	Number of pieces	Specification	Number of pieces	Specification	Number of pieces	Specification	Number of pieces	Specification
1600A	400	2	30*5	1	30*10	2	30*5	1	30*10	2	30*5	1	30*10
	630	2	40*5	1	40*10	2	40*5	1	40*10	2	40*5	1	40*10
	800	2	50*5	1	50*10	2	50*5	1	50*10	2	50*5	1	50*10
	1000	3	50*5	2	40*10	3	50*5	2	40*10	3	50*5	2	40*10
	1250	4	40*5	2	40*10	4	50*5	2	50*10	4	50*5	2	50*10
	1600	4	50*5	2	50*10	4	50*5	2	50*10	4	50*5	2	50*10
2000A	630	2	40*5	1	40*10	2	50*5	1	50*10	2	60*5	1	60*10
	800	2	50*5	1	50*10	2	50*5	1	50*10	2	60*5	1	60*10
	1000	3	50*5	2	40*10	3	50*5	2	40*10	3	60*5	2	50*10
	1250	3	60*5	2	50*10	3	60*5	2	50*10	3	60*5	2	50*10
	1600	4	60*5	2	60*10	4	60*5	2	60*10	4	60*5	2	60*10
	2000	6	60*5	3	60*10	6	60*5	3	60*10	6	60*5	3	60*10
3200A	1600	2	100*5	1	100*10	2	100*5	1	100*10	2	100*5	1	100*10
	2000	4	100*5	2	100*10	4	100*5	2	100*10	4	100*5	2	100*10
	2500	4	100*5	2	100*10	4	100*5	2	100*10	4	100*5	2	100*10
	3200	8	100*5	4	100*10	8	100*5	4	100*10	8	100*5	4	100*10
4000A	3200	8	100*5	4	100*10	8	100*5	4	100*10	8	100*5	4	100*10
	3600	7	120*5	3	120*12	7	120*5	3	120*12	7	120*5	3	120*12
	4000	8	120*5	4	120*10	8	125*5	4	125*10	8	125*5	4	125*10
6300A	4000	12	100*5	6	100*10	12	100*5	6	100*10	14	100*5	7	100*10
	5000	14	100*5	7	100*10	14	100*5	7	100*10	16	100*5	8	100*10
	6300	16	100*5	8	100*10	16	100*5	8	100*10	18	100*5	9	100*10

Note:

- When a copper bar selected by users is not matched with a wiring terminal of the circuit breaker, extended busbar is required to be designed to transfer, and is designed by the users of their own. The cross section of the extended busbar cannot be less than the requirement in the table above. The interval among the extended busbar is not less than the interval among wiring terminals of the circuit breaker.
- After the busbar recommended in the table above is installed, the electric clearance between adjacent phases of the circuit breaker is not less than 18mm.
- Electrical elements are used for three-phase rectification and high-frequency inversion, such as a high-frequency induction heating furnace (medium-frequency furnace steelmaking equipment), a solid high-frequency welding machine (such as an embedded arc electric welding machine), vacuum heating smelting equipment (such as a monocrystalline silicon growth furnace), in load equipment by controlled silicon. When a circuit breaker is selected, the influence on the circuit breaker by higher order harmonic component generated by controlled silicon is required to be considered besides the influences by the environment temperature and altitude height. At the same time, capacity derating is required, and the capacity coefficient (0.5-0.8) is recommended.
- The electric clearance of fastening bolts of upper and lower busbar needs to be not less than 20mm after the installation of the busbar by users.
- After the installation of the circuit breaker, the safety clearance among electrified bodies with different electric potential and between the electrified bodies and the ground are not less than 18mm.

Functions and features


Selective protection between NM8 and NXA

Selective protection between NM8 and NXA			Upstream	Frame size rated current	NXA16						NXA20		
Downstream				Rated current (A)	400	630	800	1000	1250	1600	630	800	
				Default setting ratings of short time-delay 8In (kA)	3.2	5.04	6.4	8	10	12.8	5.04	6.4	
				Setting ratings (kA)	0.8~4	1.26~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.26~6.3	1.6~8	
				Delayed tripping time (s)	0.1 , 0.2 , 0.3 , 0.4								
				Returnable time	0.05 , 0.14 , 0.25 , 0.33								
Frame size rated current	Rated current (A)	Instantaneous setting ratings (kA)											
NM8-100 NM8S-100	16	0.16			0.8~4	1.26~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.26~6.3	1.6~8	
		0.19 (Motor)			0.8~4	1.26~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.26~6.3	1.6~8	
	20	0.2			0.8~4	1.26~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.26~6.3	1.6~8	
		0.24 (Motor)			0.8~4	1.26~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.26~6.3	1.6~8	
	25	0.25			0.8~4	1.26~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.26~6.3	1.6~8	
		0.30 (Motor)			0.8~4	1.26~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.26~6.3	1.6~8	
	32	0.32			0.8~4	1.26~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.26~6.3	1.6~8	
		0.38 (Motor)			0.8~4	1.26~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.26~6.3	1.6~8	
	40	0.4			0.8~4	1.26~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.26~6.3	1.6~8	
		0.48 (Motor)			0.8~4	1.26~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.26~6.3	1.6~8	
	50	0.5			0.8~4	1.26~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.26~6.3	1.6~8	
		0.60 (Motor)			0.828~4	1.26~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.26~6.3	1.6~8	
	63	0.63			0.869~4	1.26~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.26~6.3	1.6~8	
		0.75 (Motor)			1.035~4	1.26~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.26~6.3	1.6~8	
	80	0.8			1.104~4	1.26~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.26~6.3	1.6~8	
		0.96 (Motor)			1.325~4	1.324~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.324~6.3	1.6~8	
	100	1			1.380~4	1.380~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.380~6.3	1.6~8	
		1.20 (Motor)			1.656~4	1.656~6.3	1.656~8	2~10	2.5~12.5	3.2~16	1.656~6.3	1.656~8	
NM8-250 NM8S-250	100	1			1.380~4	1.380~6.3	1.6~8	2~10	2.5~12.5	3.2~16	1.380~6.3	1.6~8	
		1.20 (Motor)			1.656~4	1.656~6.3	1.656~8	2~10	2.5~12.5	3.2~16	1.656~6.3	1.656~8	
	125	1.25			1.725~4	1.725~6.3	1.725~8	2~10	2.5~12.5	3.2~16	1.725~6.3	1.725~8	
		1.5 (Motor)			2.070~4	2.070~6.3	2.070~8	2.070~10	2.5~12.5	3.2~16	2.070~6.3	2.070~8	
	160	1.6			2.208~4	2.208~6.3	2.208~8	2.208~10	2.5~12.5	3.2~16	2.208~6.3	2.208~8	
		1.92 (Motor)			2.650~4	2.649~6.3	2.649~8	2.649~10	2.649~12.5	3.2~16	2.649~6.3	2.649~8	
	180	1.8			2.484~4	2.484~6.3	2.484~8	2.484~10	2.500~12.5	3.2~16	2.484~6.3	2.484~8	
		2.16 (Motor)			2.981~4	2.980~6.3	2.980~8	2.980~10	2.980~12.5	3.2~16	2.980~6.3	2.980~8	
	200	2			2.760~4	2.760~6.3	2.760~8	2.760~10	2.760~12.5	3.2~16	2.760~6.3	2.760~8	
		2.4 (Motor)			3.312~4	3.312~6.3	3.312~8	3.312~10	3.312~12.5	3.312~16	3.312~6.3	3.312~8	
	225	2.25			3.105~4	3.105~6.3	3.105~8	3.105~10	3.105~12.5	3.200~16	3.105~6.3	3.105~8	
		2.7 (Motor)			3.726~4	3.726~6.3	3.726~8	3.726~10	3.726~12.5	3.720~16	3.726~6.3	3.726~8	
250	2.5			3.450~4	3.450~6.3	3.450~8	3.450~10	3.450~12.5	3.450~16	3.450~6.3	3.450~8		
	3.0 (Motor)			/	4.140~6.3	4.140~8	4.140~10	4.140~12.5	4.140~16	4.140~6.3	4.140~8		
NM8-630 NM8S-630	250	2.5			3.450~4	3.450~6.3	3.450~8	3.450~10	3.450~12.5	3.450~16	3.450~6.3	3.450~8	
		3.0 (Motor)			/	4.140~6.3	4.140~8	4.140~10	4.140~12.5	4.140~16	4.140~6.3	4.140~8	
	315	3.15			/	4.347~6.3	4.347~8	4.347~10	4.347~12.5	4.347~16	4.347~6.3	4.347~8	
		3.78 (Motor)			/	5.216~6.3	5.216~8	5.216~10	5.216~12.5	5.216~16	5.216~6.3	5.216~8	
	350	3.5			/	4.830~6.3	4.830~8	4.830~10	4.830~12.5	4.830~16	4.830~6.3	4.830~8	
		4.2 (Motor)			/	5.796~6.3	5.796~8	5.796~10	5.796~12.5	5.796~16	5.796~6.3	5.796~8	
	400	4			/	5.520~6.3	5.520~8	5.520~10	5.520~12.5	5.520~16	5.520~6.3	5.520~8	
		4.8 (Motor)			/	/	6.624~8	6.624~10	6.624~12.5	6.624~16	/	6.624~8	
	500	5			/	/	6.900~8	6.900~10	6.900~12.5	6.900~16	/	6.900~8	
		6.0 (Motor)			/	/	/	8.280~10	8.280~12.5	8.280~16	/	/	
	NM8-1250 NM8S-1250	630	6.3			/	/	/	8.694~10	8.694~12.5	8.694~16	/	/
			7.56 (Motor)			/	/	/	/	10.43~12.5	10.43~16	/	/
700		7			/	/	/	9.660~10	9.660~12.5	9.660~16	/	/	
		8.4 (Motor)			/	/	/	/	11.59~12.5	11.59~16	/	/	
800		8			/	/	/	/	11.04~12.5	11.04~16	/	/	
		9.6 (Motor)			/	/	/	/	/	13.24~16	/	/	
1000		10			/	/	/	/	/	13.80~16	/	/	
		12 (Motor)			/	/	/	/	/	/	/	/	
1250	12.5			/	/	/	/	/	/	/	/		
	15.0 (Motor)			/	/	/	/	/	/	/	/		


Installation and wiring

Dimensions and installation

1600A fixed type

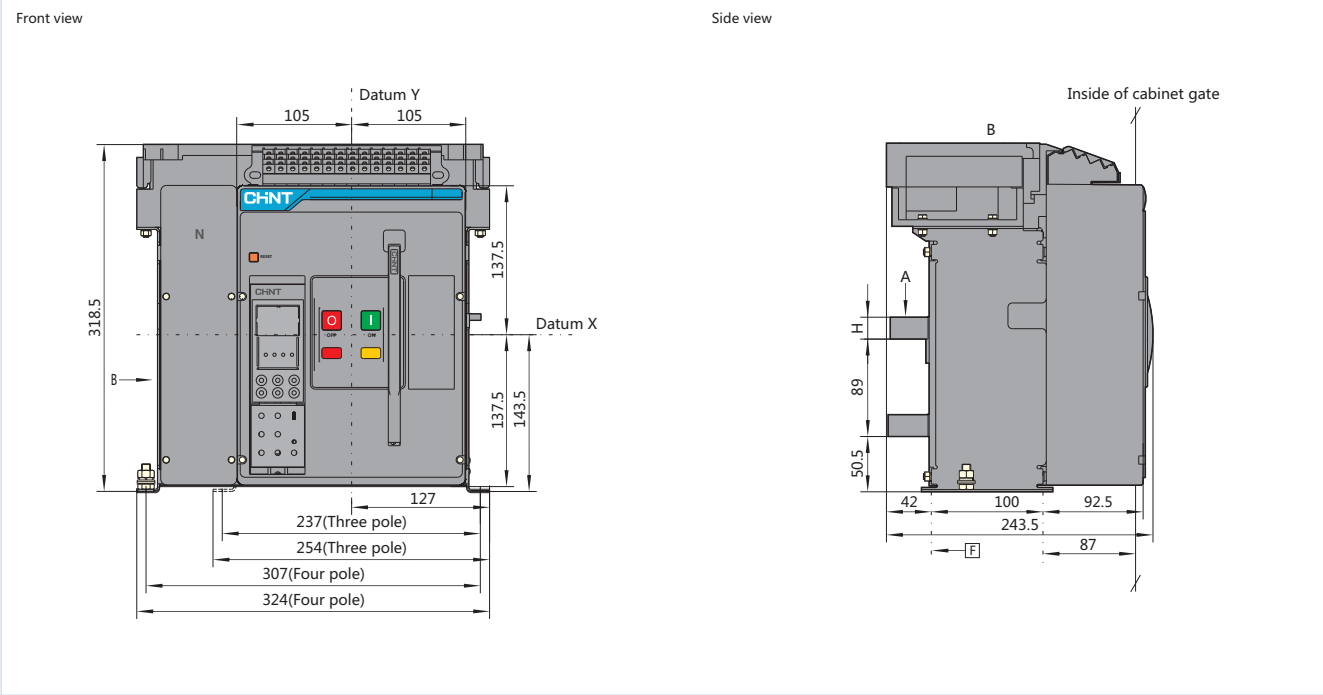


Hole size


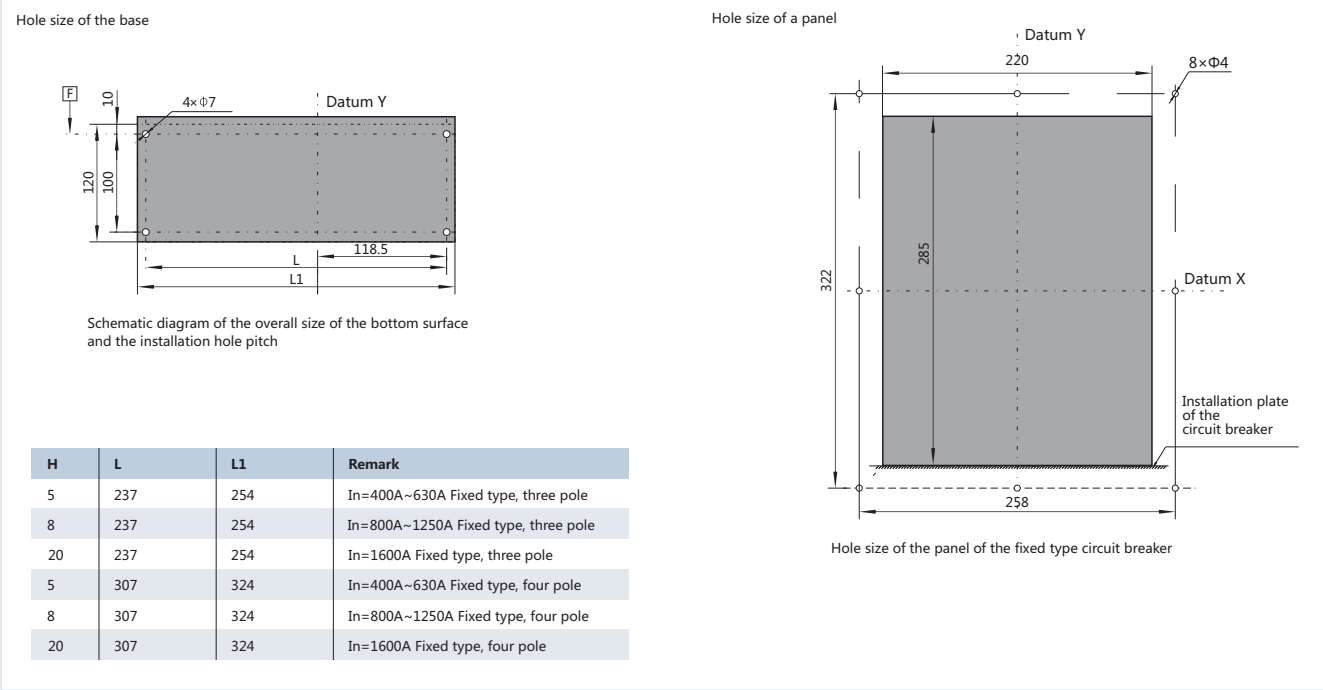


Horizontal connection


Side view

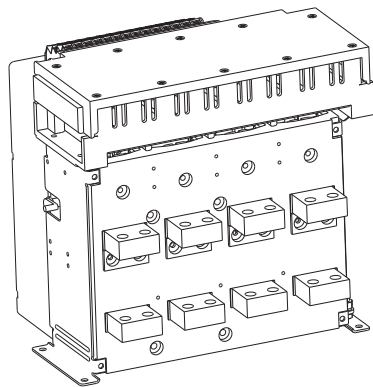

Busbar size and busbar interval

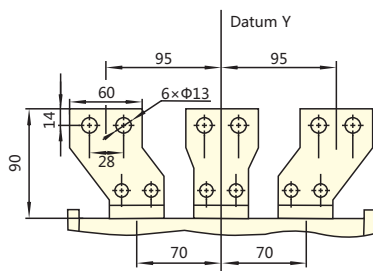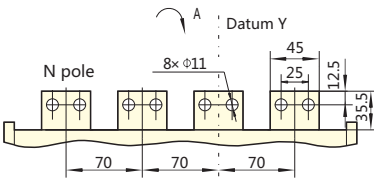

(Optional)

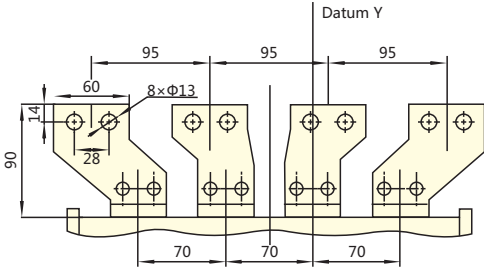


(Optional)

Number of busbar


"Rated current (A)"	Number of pieces			
	Three poles		Four poles	
	A pole+C pole	B pole	A pole+B pole	C pole+N pole
400 ~ 630	4	2	4	4
800 ~ 1250	4	2	4	4
1600	8	4	8	8

Installation and wiring

1600A draw-out type

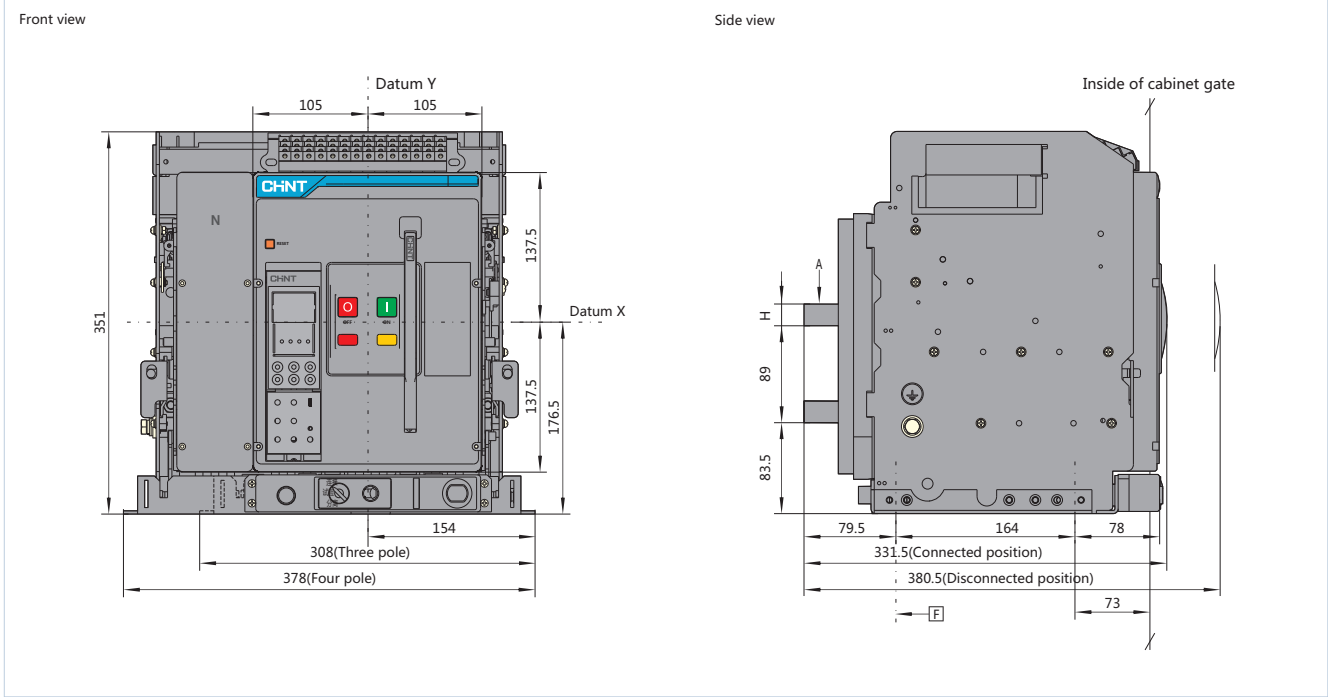


Hole size



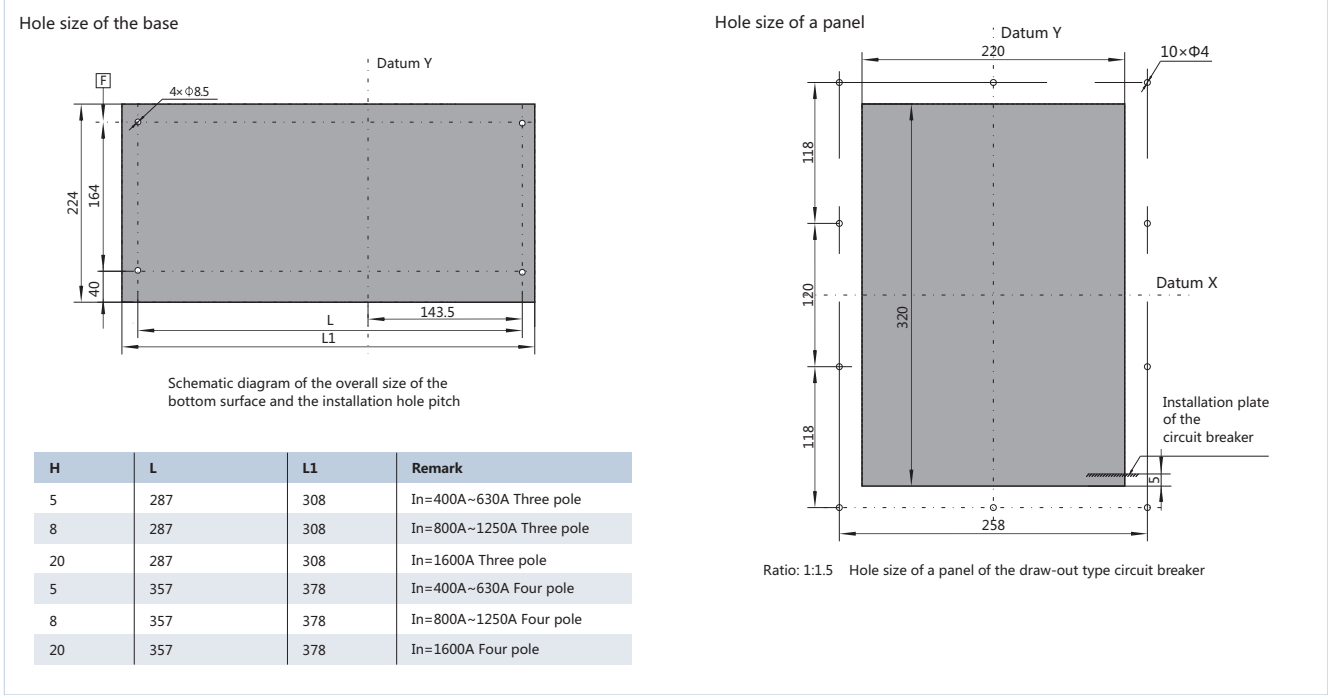


Horizontal connection

Side view

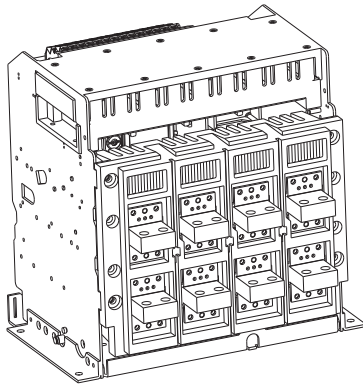

Busbar size and interval

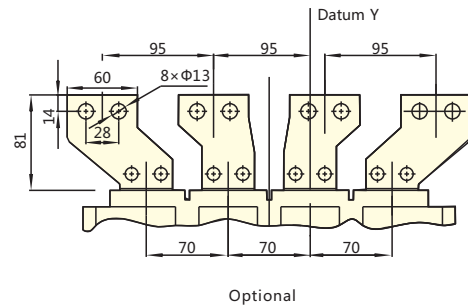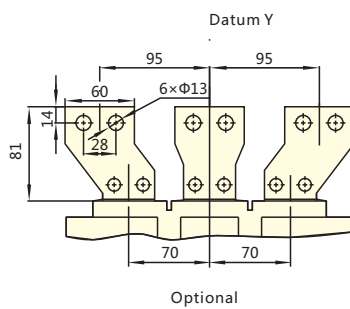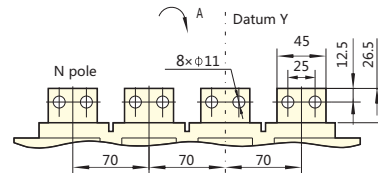


Number of busbar


"Rated current (A) "	Number of pieces			
	Three poles		Four poles	
	A pole+C pole	B pole	A pole+B pole	C pole+N pole
400 ~ 630	4	2	4	4
800 ~ 1250	4	2	4	4
1600	8	4	8	8

Installation and wiring

2000A fixed type

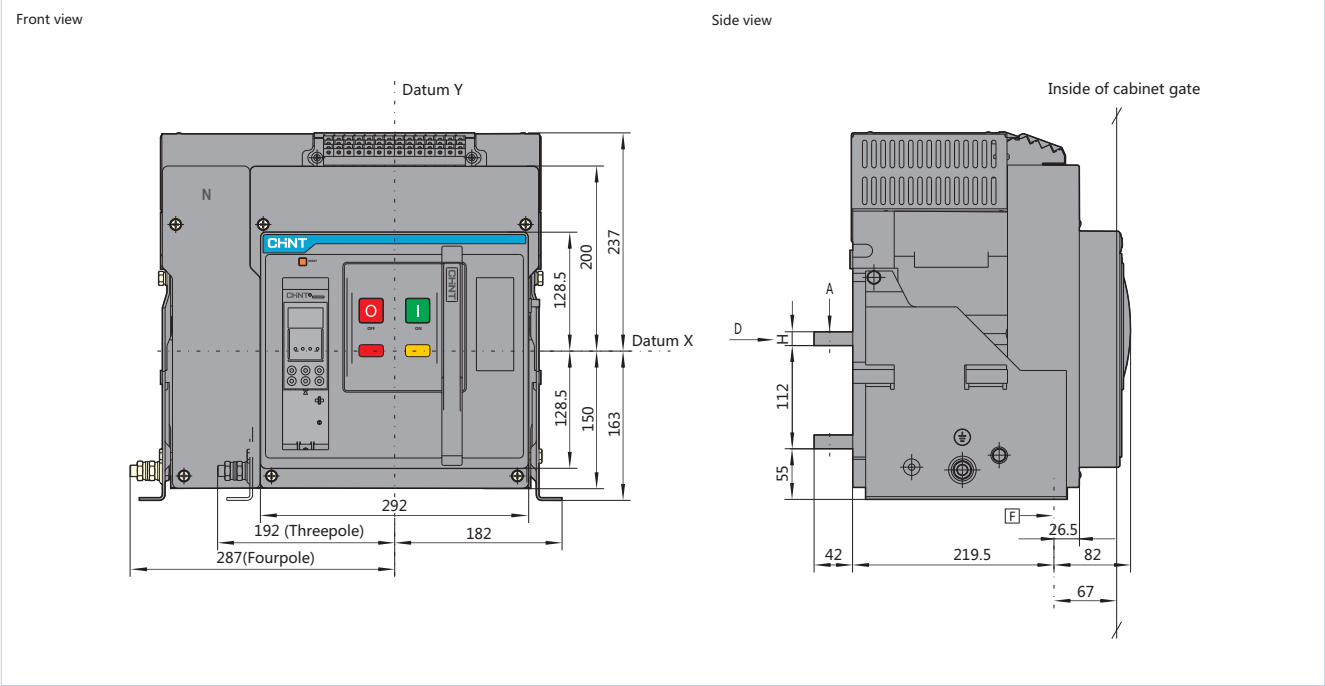


Hole size



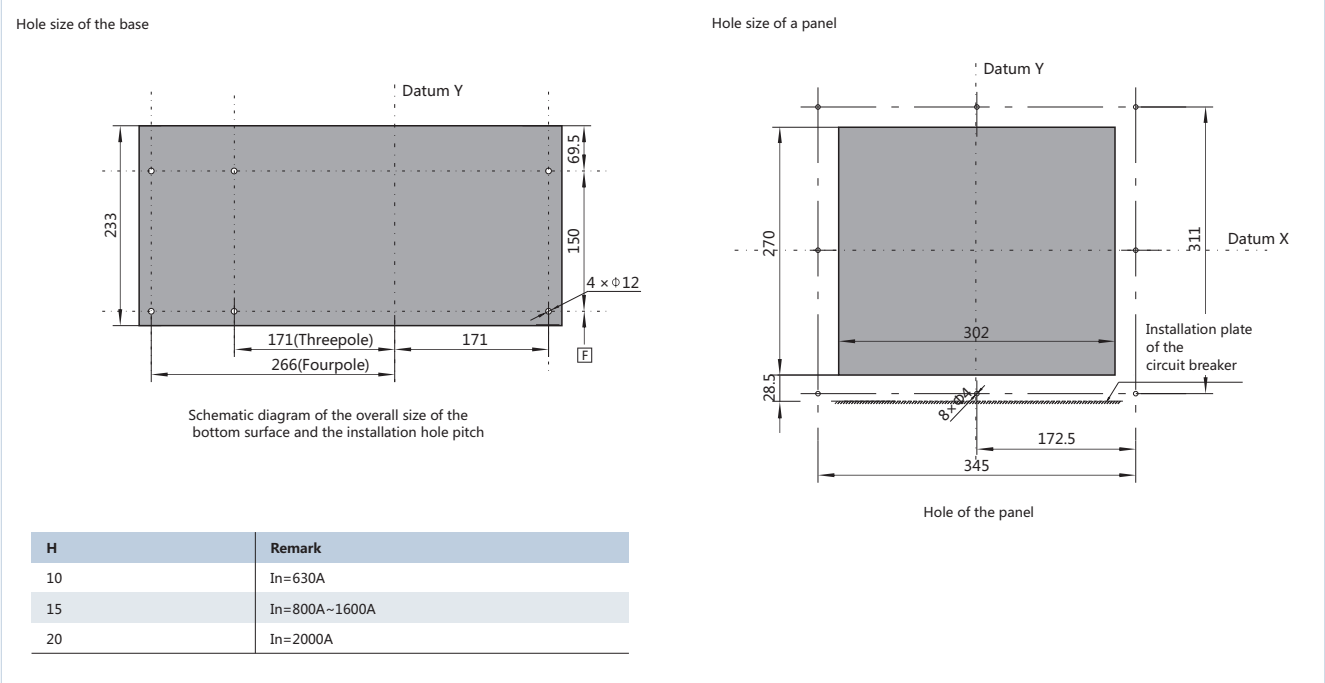


Horizontal connection

Side view

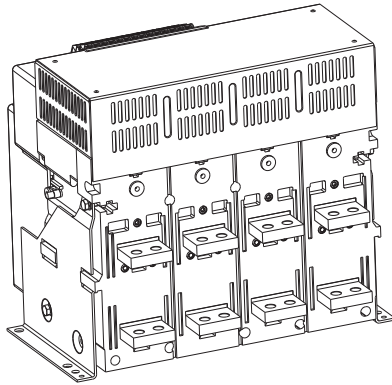


Busbar size and interval

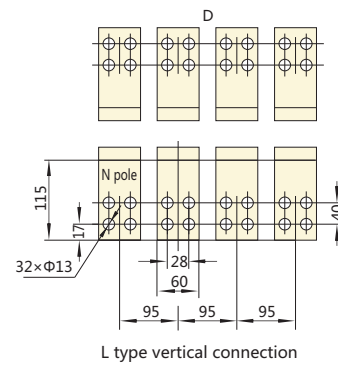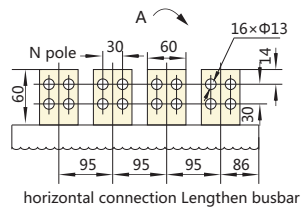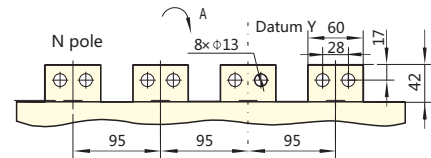


Installation and wiring

2000A draw-out type

Front view

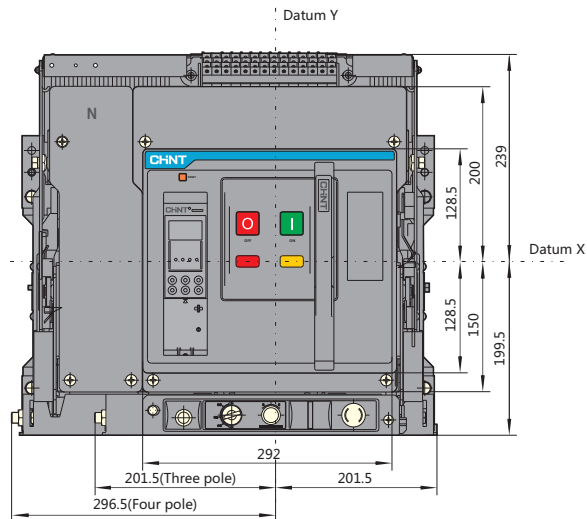


Side view

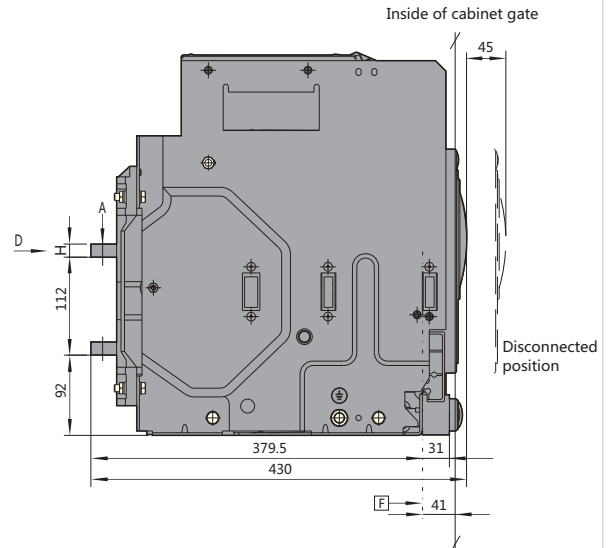


Hole size

Hole size of the base

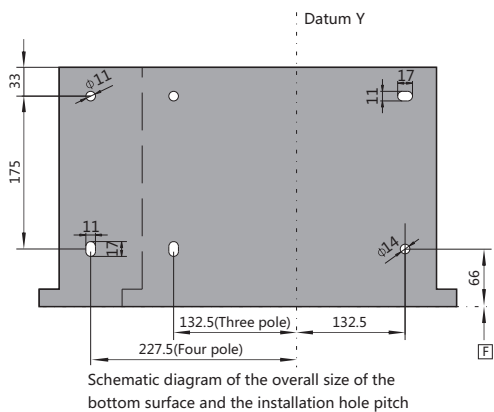

Hole size of a panel

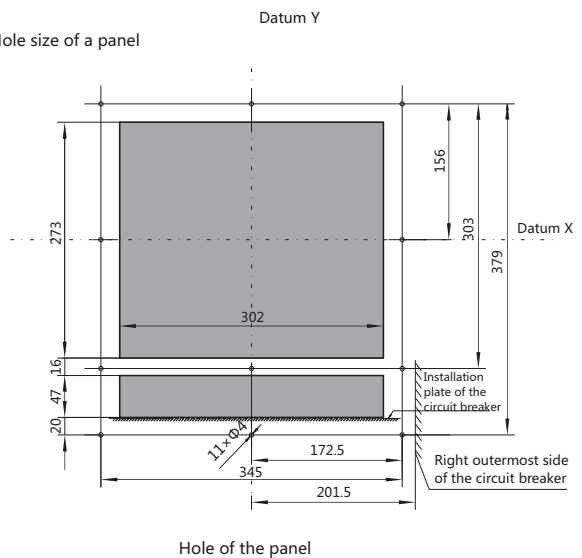


Hole of the panel



H	Remark
10	In=630A
15	In=800A~1600A
20	In=2000A

Horizontal connection


Side view

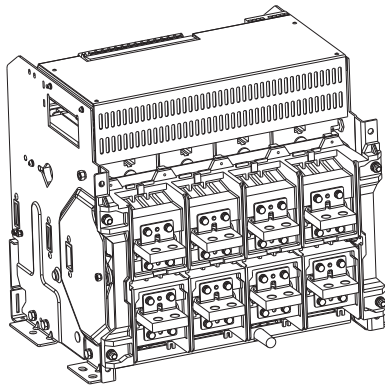

Busbar size and interval

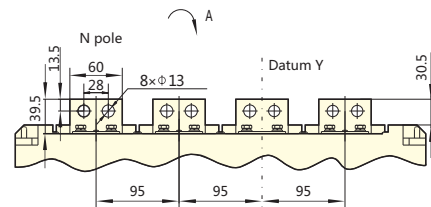

horizontal connection Lengthen busbar

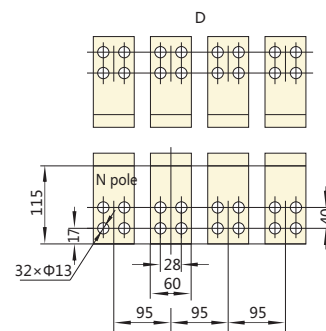


L type vertical connection


Installation and wiring

3200A fixed type

Front view

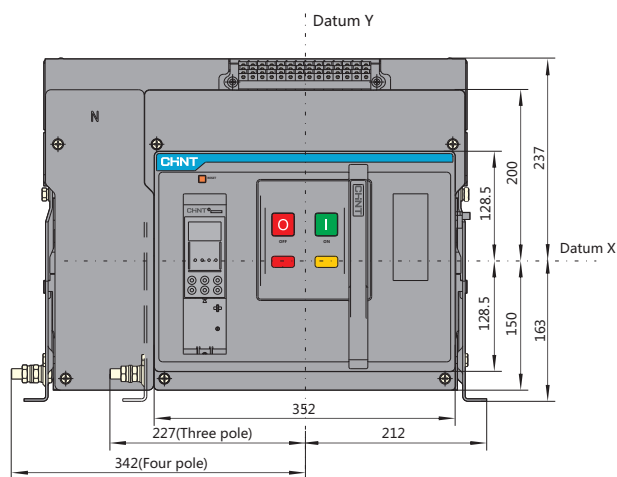


Side view

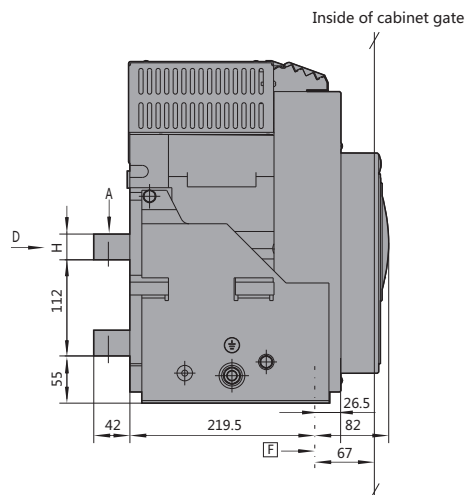


Hole size

Hole size of the base

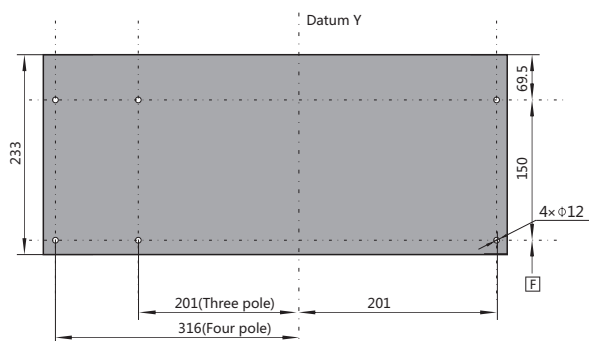

Schematic diagram of the overall size of the bottom surface and the installation hole pitch

Hole of the panel

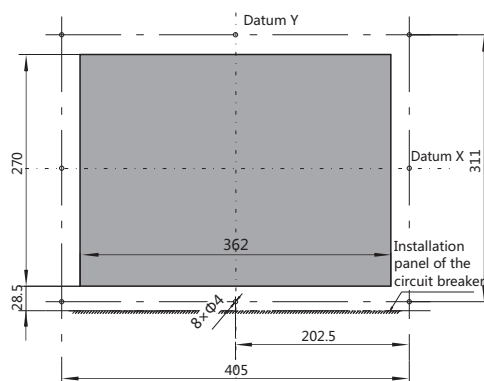


Horizontal connection




H	Remark
20	In=1600A~2500A
30	In=3200A

Horizontal connection

Side view

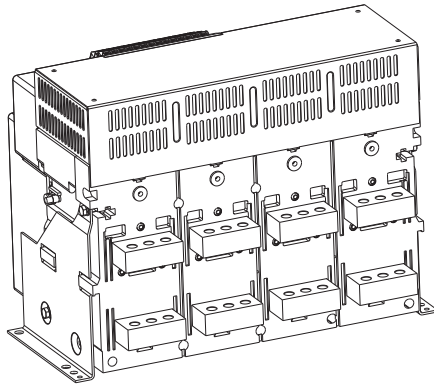


Busbar size and interval

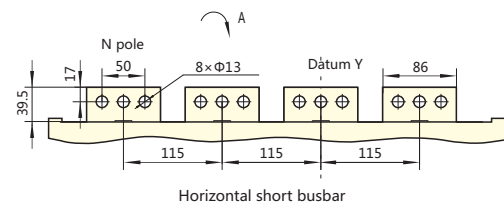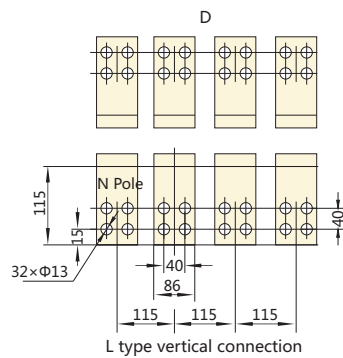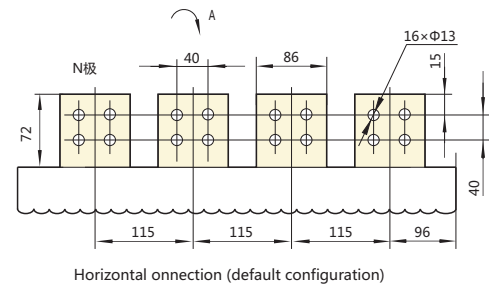


Installation and wiring

3200A draw-out type(Default configuration)

Front view

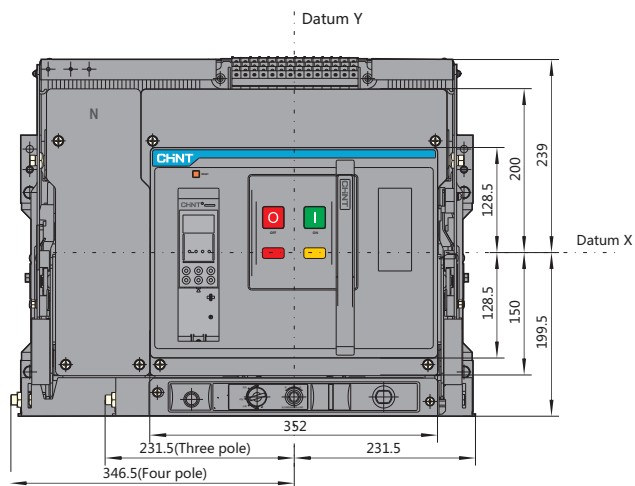


Side view

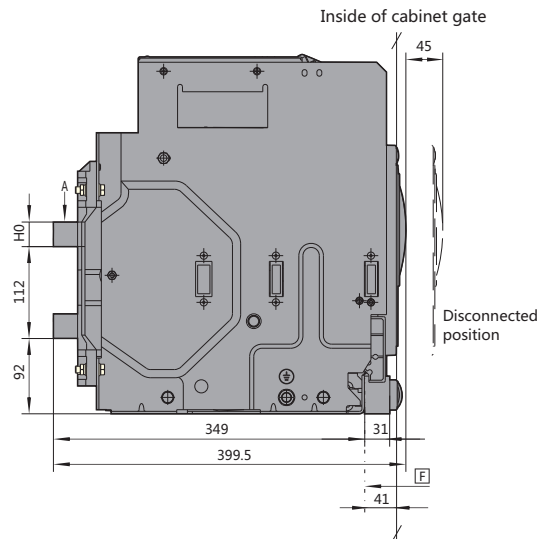


3200A draw-out type(Horizontal short busbar)

Front view

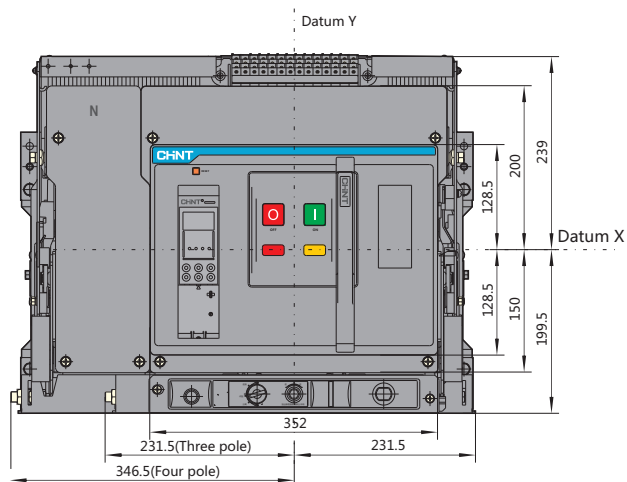


Side view

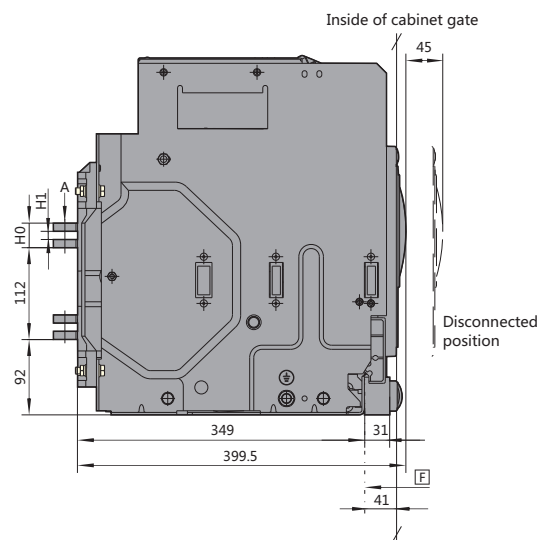


Hole size

Hole size of the base

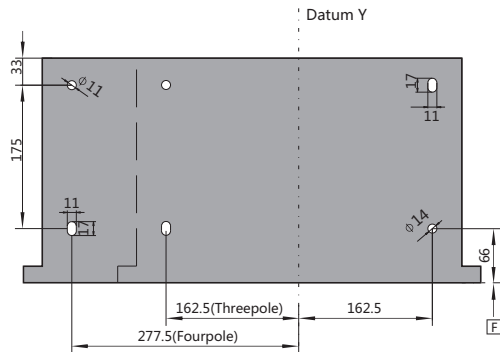

Schematic diagram of the overall size of the bottom surface and the installation hole pitch

Hole size of a panel

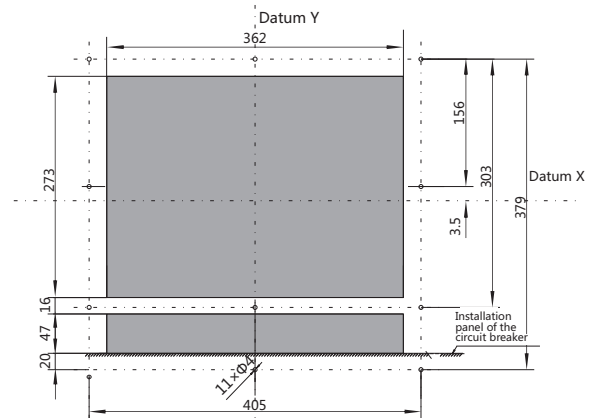


Hole of the panel


H0	H1	Remark
20	0	In=1600A~2500A
30	$10^{+0.1}_0$	In=3200A

Horizontal connection


Side view

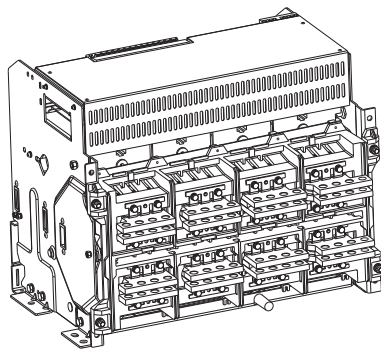


Busbar size and interval

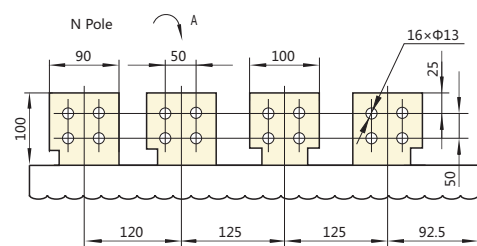

Horizontal connection(Default configuration)

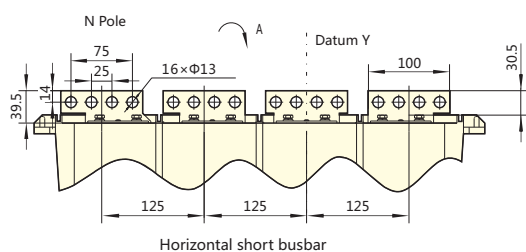


Horizontal short busbar

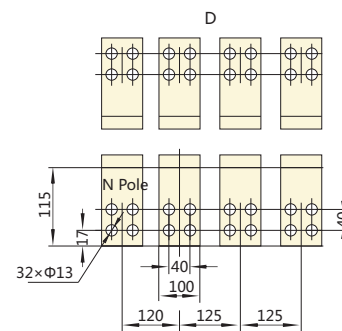


L type vertical connection

Installation and wiring

4000A fixed type

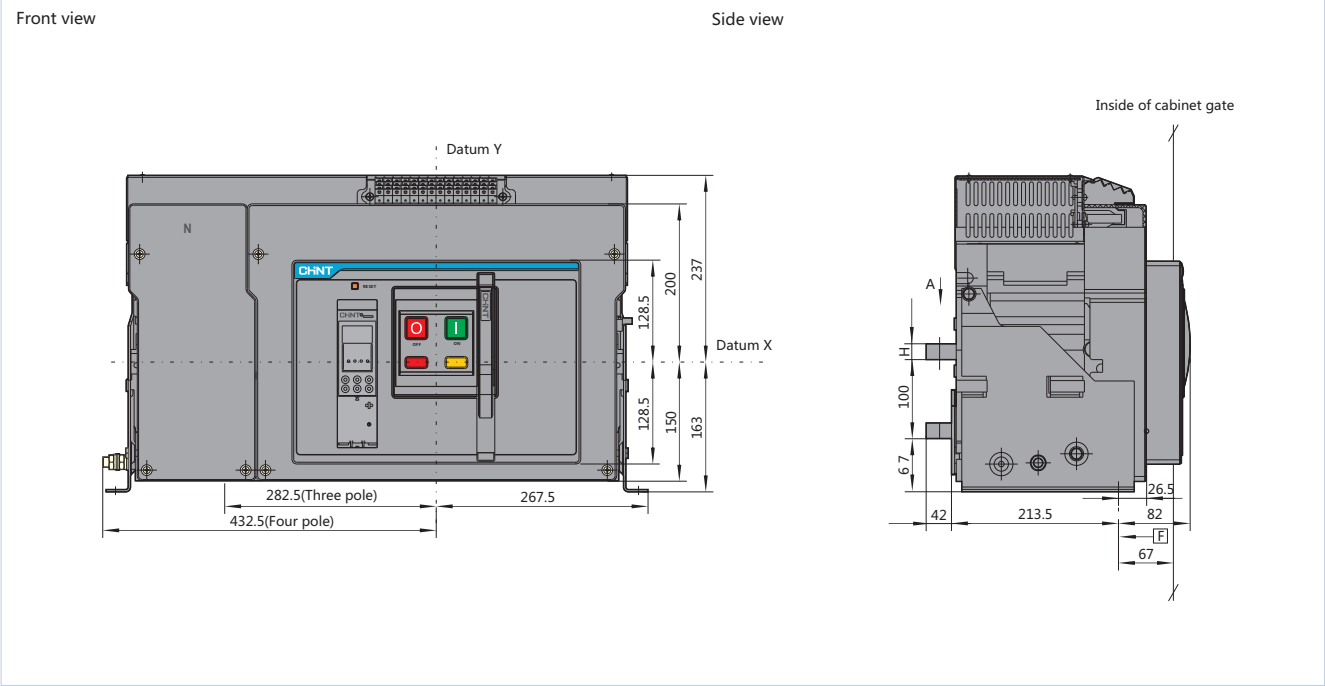


Hole size

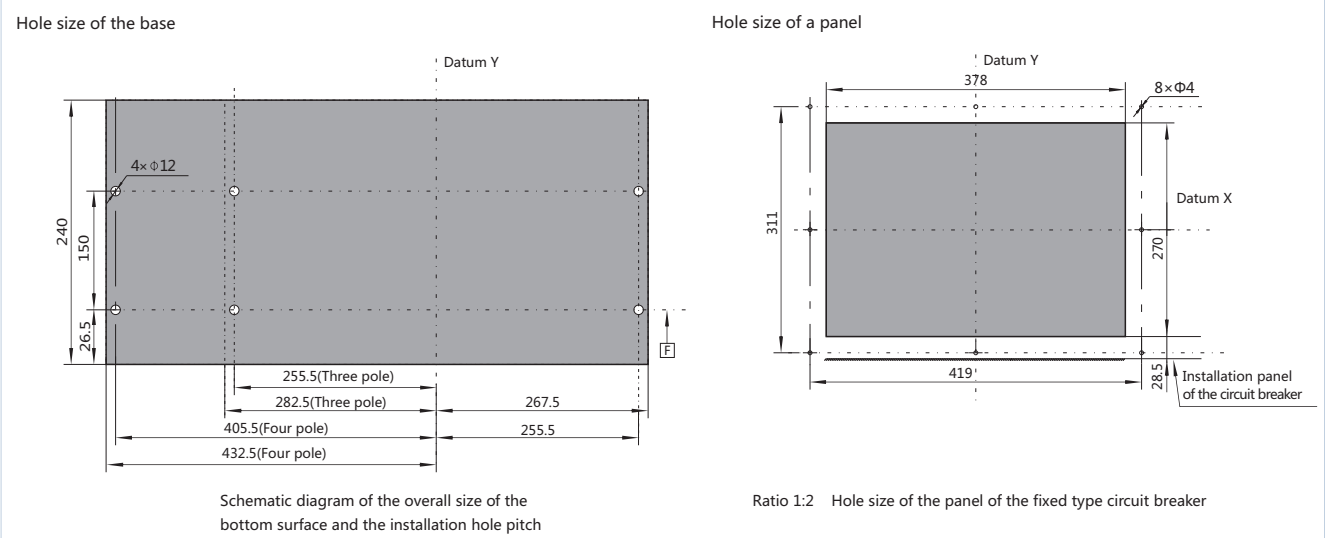


H	Remark
16	In=3200A
20	In=3600A~4000A

Horizontal connection

Side view

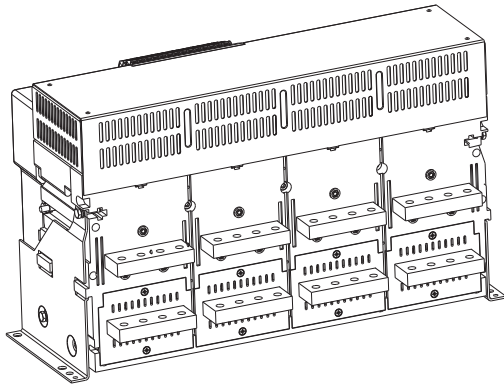


Busbar size and interval

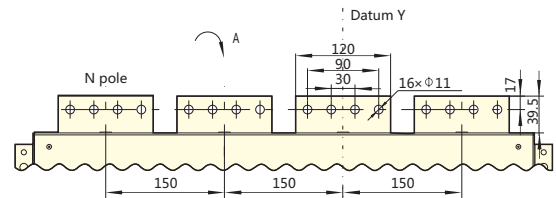


Installation and wiring

4000A draw-out type

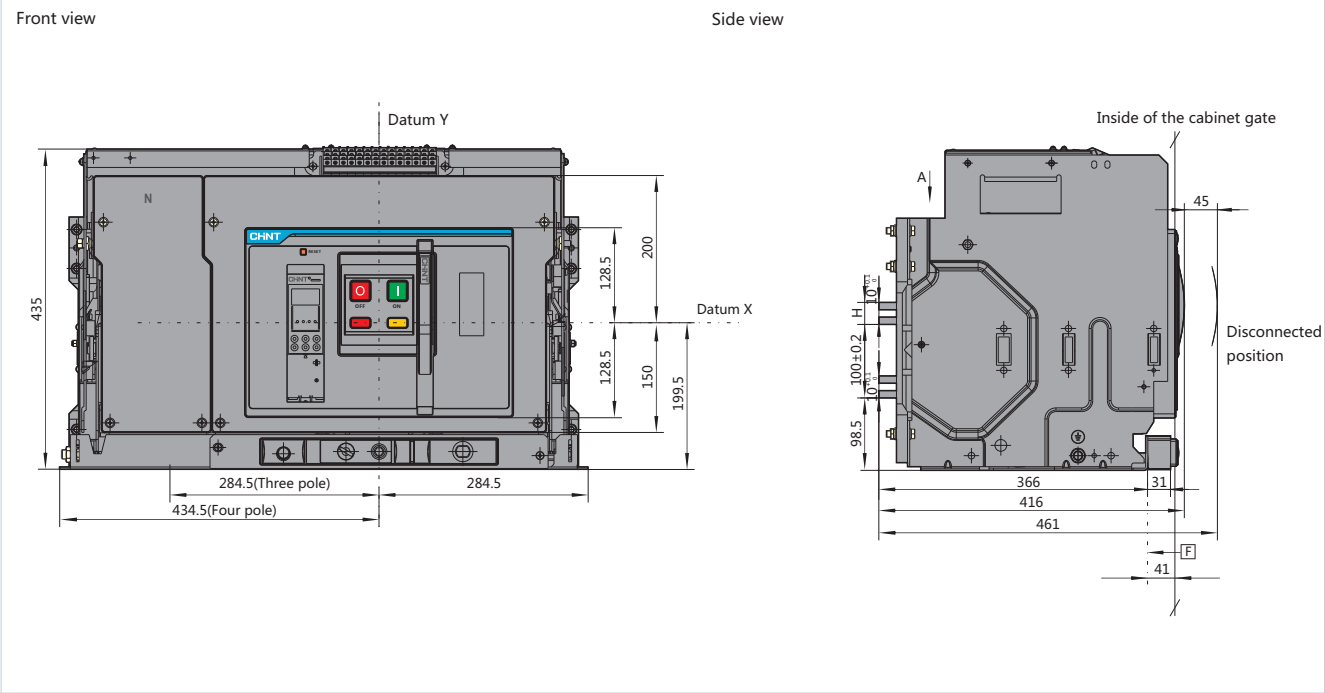


Hole size

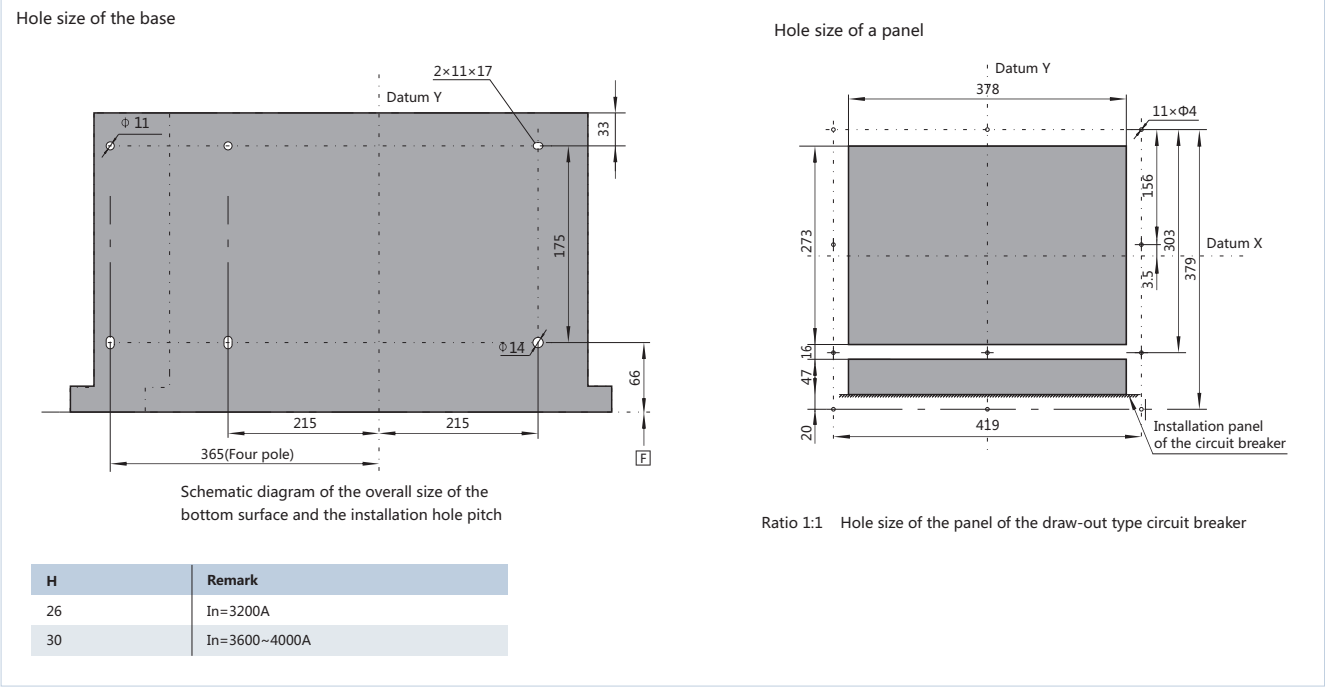


Horizontal connection

Side view

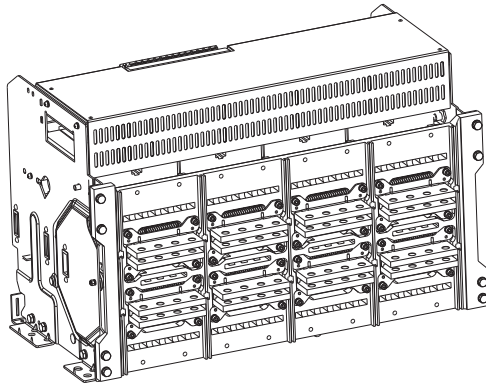


Busbar size and interval

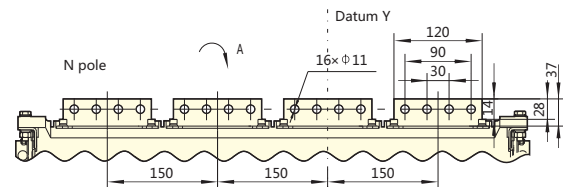


Installation and wiring

6300A fixed type

Front view

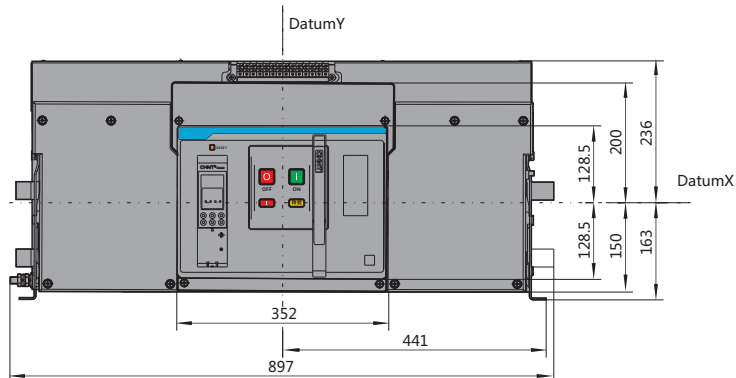


Side view

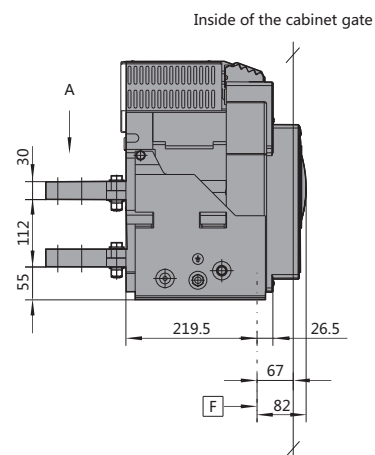


Hole size

Hole size of the base

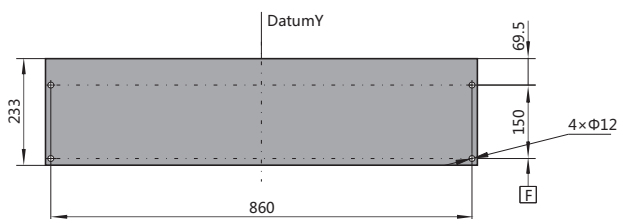

Schematic diagram of the overall size of the bottom surface and the installation hole pitch


Hole size of panel

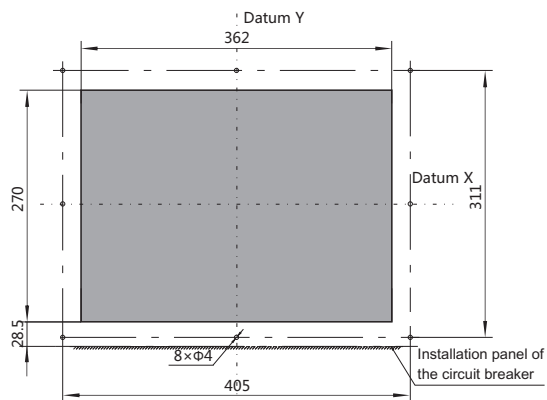


Hole size of the panel of the fixed type circuit breaker

Horizontal connection

Side view

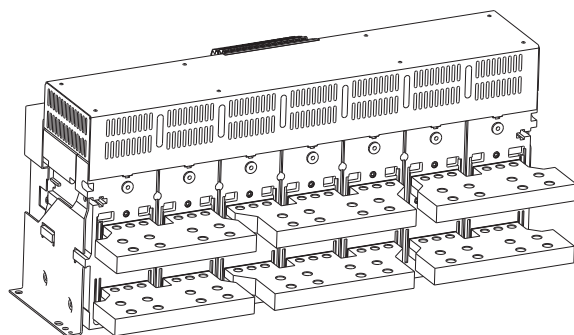


Busbar size and interval

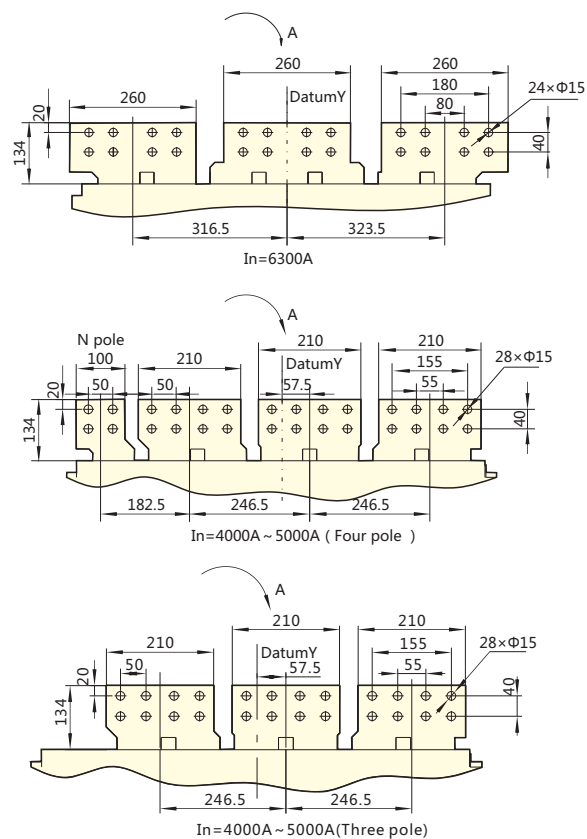


Installation and wiring

6300A draw-out type

Front view

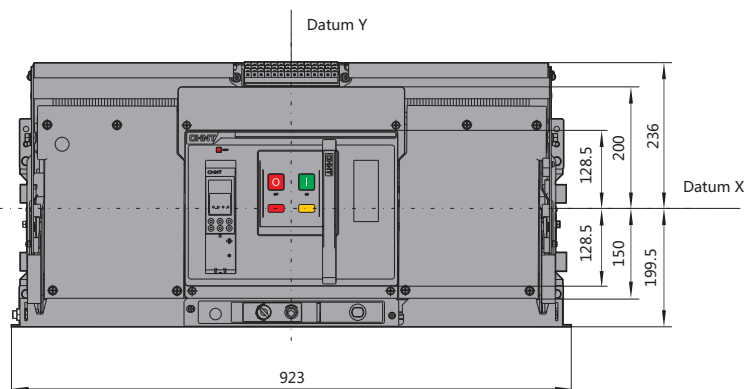


Side view

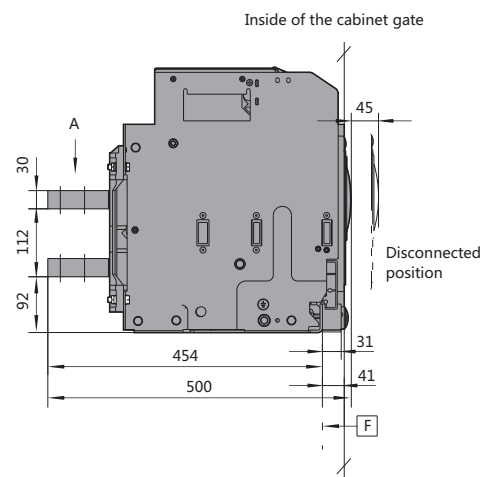


Hole size

Hole size of the base

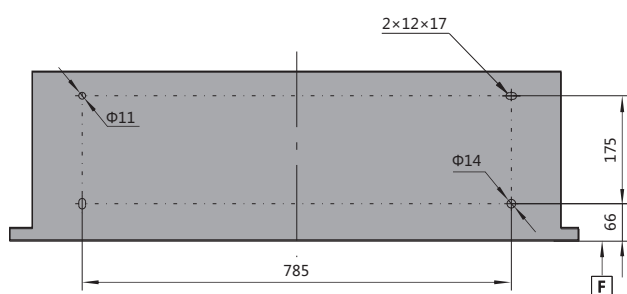

Hole size of the panel of the fixed type circuit breaker


Hole size of panel

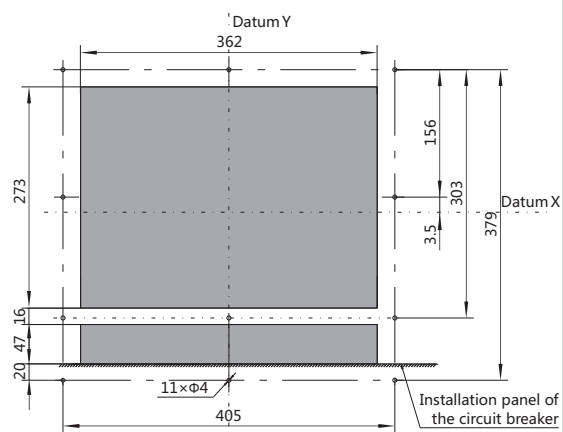




Hole size of the panel of the draw-out type circuit breaker

Horizontal connection

Side view

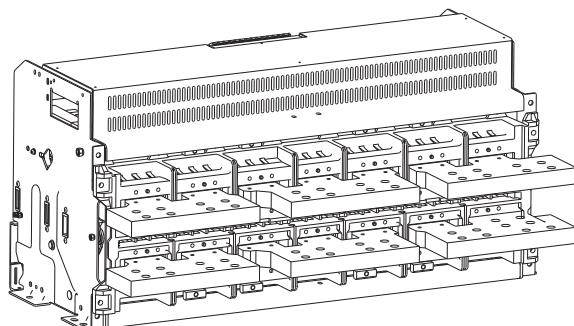

Busbar size and interval

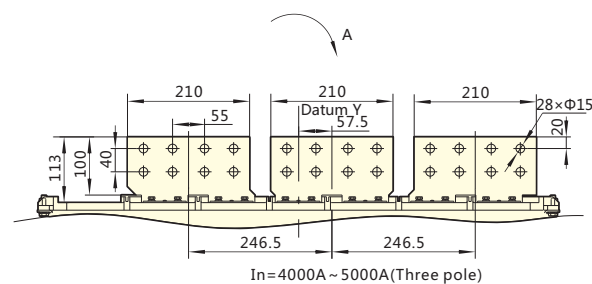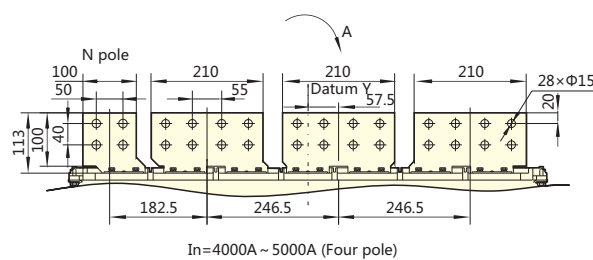
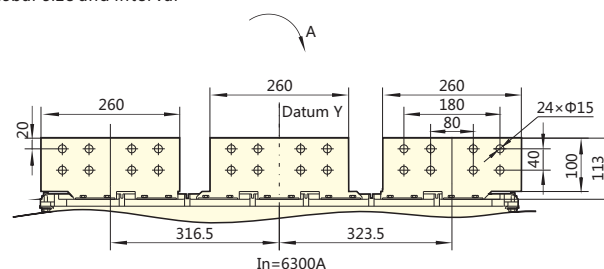


Installation and wiring

External transformer (Neutral CT) (3P+N mode)

External transformer (Neutral CT) dimension

The installation overall dimension of an external N-phase transformer is as below when the controller is of 3P+N type.
The transformer is provided by the manufacturer. A connection copper bar and an installation support are manufactured by users.

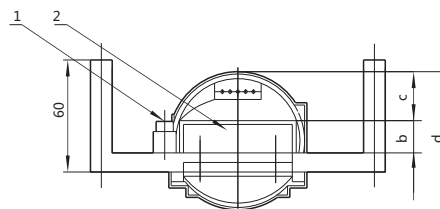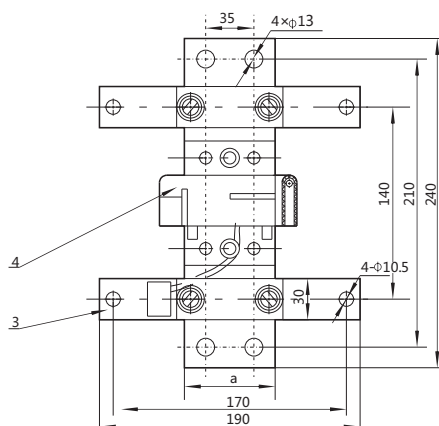


1-Wiring panel 2-Busbar 3-Fixation panel 4-Transformer

Frame size	a	b	c	d
1600	45	20	40	88
2000	60	20	34	89
3200	80	20	35	110
4000	120	20	16	58
6300	80	20	35	110


4CT Type earth current transformer

Structural dimension of external earth current transformer (W type)

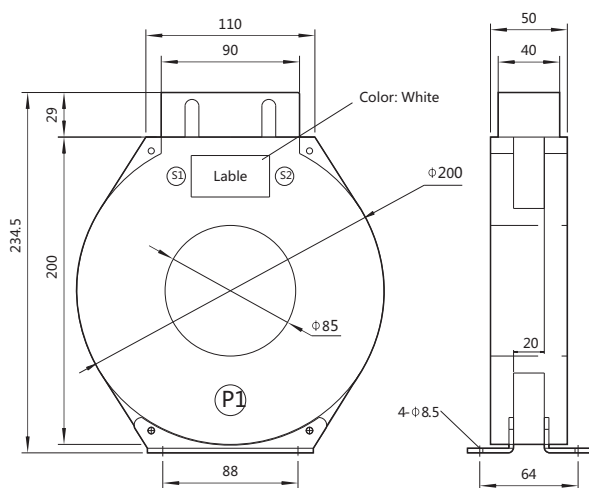

CTB-2 Type earth current transformer

Structural dimension of external earth current transformer (W type)

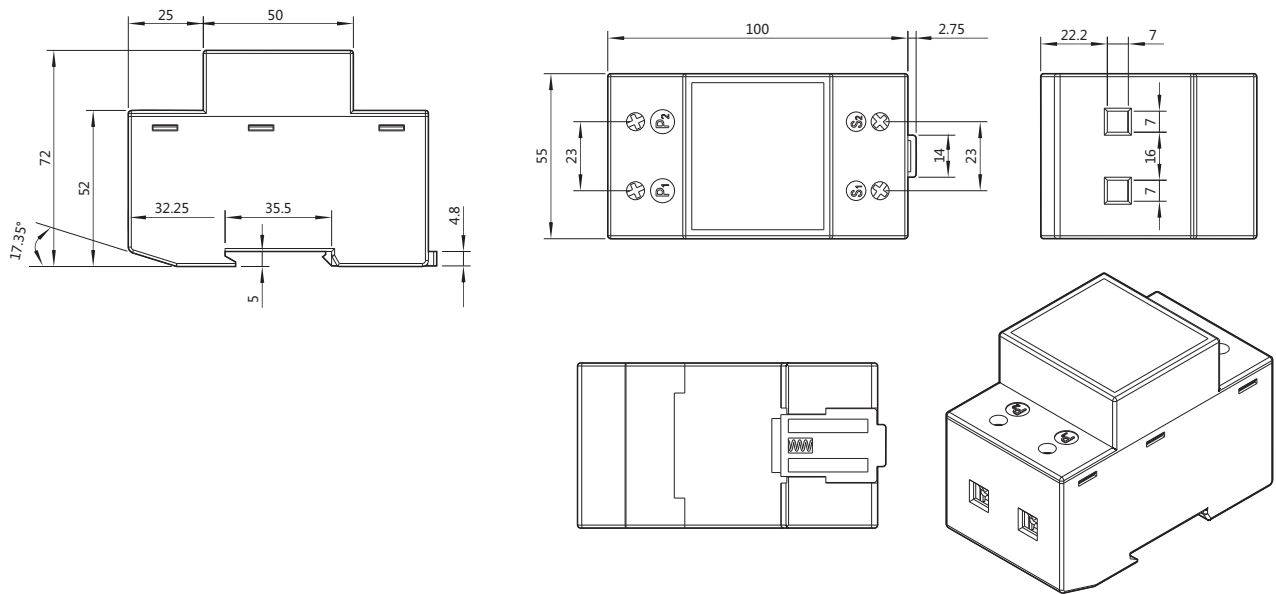


Undervoltage time delay controller

Installation overall dimension of undervoltage time-delay controller which is required to be plugged in the undervoltage time-delay tripper



1600A frame


P/H type control unit

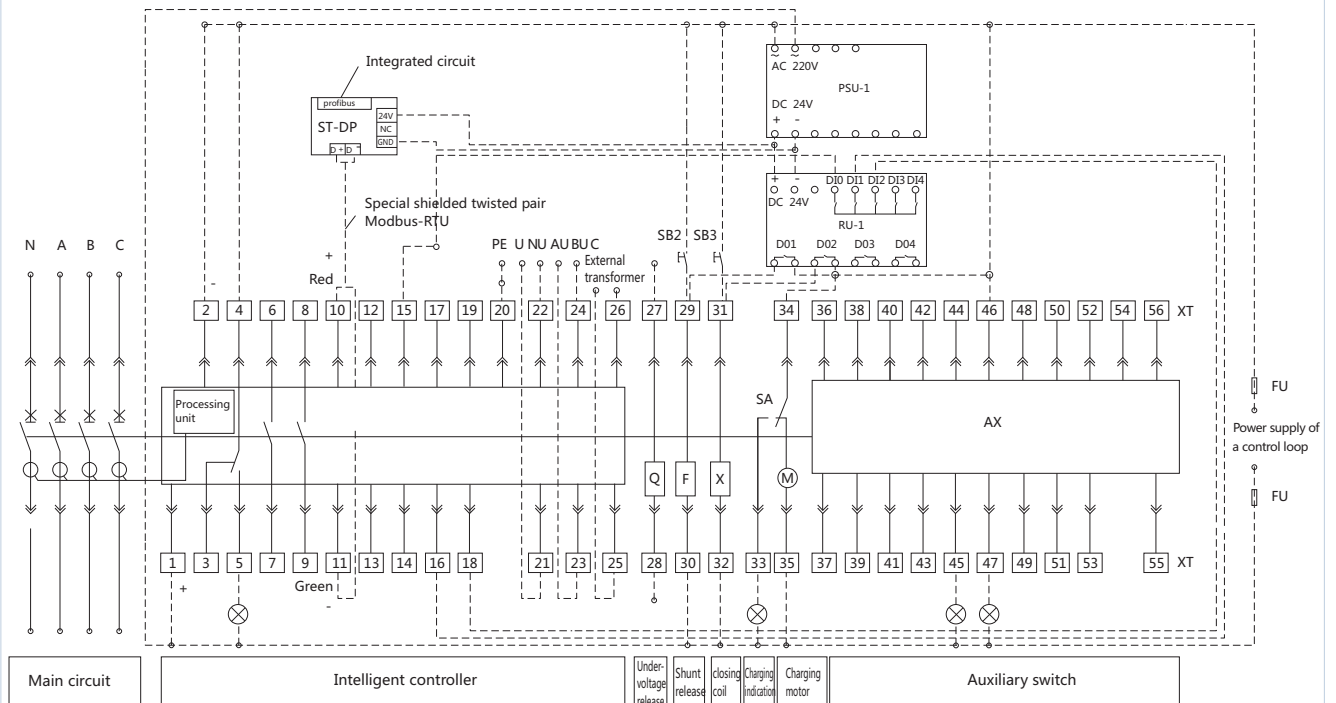

AX auxiliary contact type

For user

Four groups of adapters (Default) Six groups of adapters

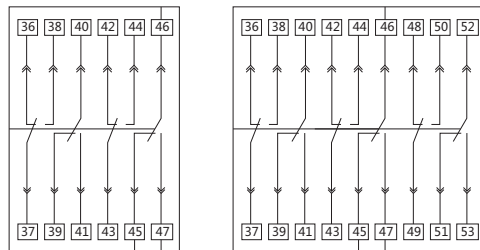


Q-Undervoltage release F-Shunt release
 X-Closing coil M-Charging motor
 SA-Limited switch XT-Wiring terminal AX-Auxiliary contact
 SB1-Emergency stop button SB2-Tripping push button
 SB3-Closing push button HL1-Failure indication lamp
 HL2-Charging indication lamp HL3-Tripping indication lamp HL4-Closing indication lamp
 FU-Fuse (6A) PSU-1—power module
 1#, 2#: Power supply of intelligent controller
 3#~5#: Tripping alarm contact (4-common point)
 6#~9#: Auxiliary contact, normally open contact
 10#~11#: Defaulted communication output contact for a H type intelligent controller. P type is empty
 12#~19#: Four groups of programmable output contacts
 12# : com, 18#:D01, 16#:D02, 14#D03, 13#D04

H type intelligent controller with a programmable output contact outputs in default: 12#, 13#: load 1 alarm, 12#, 14#: load 2 alarm, 12#,16#: tripping signal output, 12#, 18#: Closing signal output
 P type intelligent controller with a programmable output contact outputs in default: 12#, 13#: load 1 alarm, 12#, 14#: load C alarm, 12#, 16#: self-diagnosis alarm, 12#, 18#: failure tripping.
 20#: PE line.
 21#~24#: voltage display input signal contact
 P/H type intelligent controller 21#:N-phase voltage signal
 22#: A-phase voltage signal 23#:B-phase voltage signal,
 24#: C- phase voltage signal
 25#~26#: External N-phase transformer or external earth current transformer input signal contacts. Conventional products are empty. When an external transformer is required for special order for users, they are external transformer signal input contacts.
 27#, 28#: Undervoltage release (Connected to the main circuit)
 29#, 30#: Shunt release
 31#, 32#: Closing coil
 33#, 34#: Charging indication
 34#, 35#: Charging motor
 36#~56#: Auxiliary contact
 Conventional products are four groups of adapters, and six groups of adapters can be provided for special order for users (only for AC).
 ST-DP: DP protocol module. When the upper computer communication protocol is Modbus-RTU, the ST-DP protocol module is not required. When the upper computer communication protocol is Profibus-DP, the Modbus-RTU protocol module is required to be converted into Profibus-DP protocol by the ST-DP protocol module, extra fee needed.
 RU-1 :relay module. The circuit breaker is used for tripping and switching via remote control, and is used for tripping and switching signal energy amplification, extra fee needed.
 Note: The full line section is connected, and the dot line should be connected by customers.

Installation and wiring

2000-6300A frame


M/A type control unit

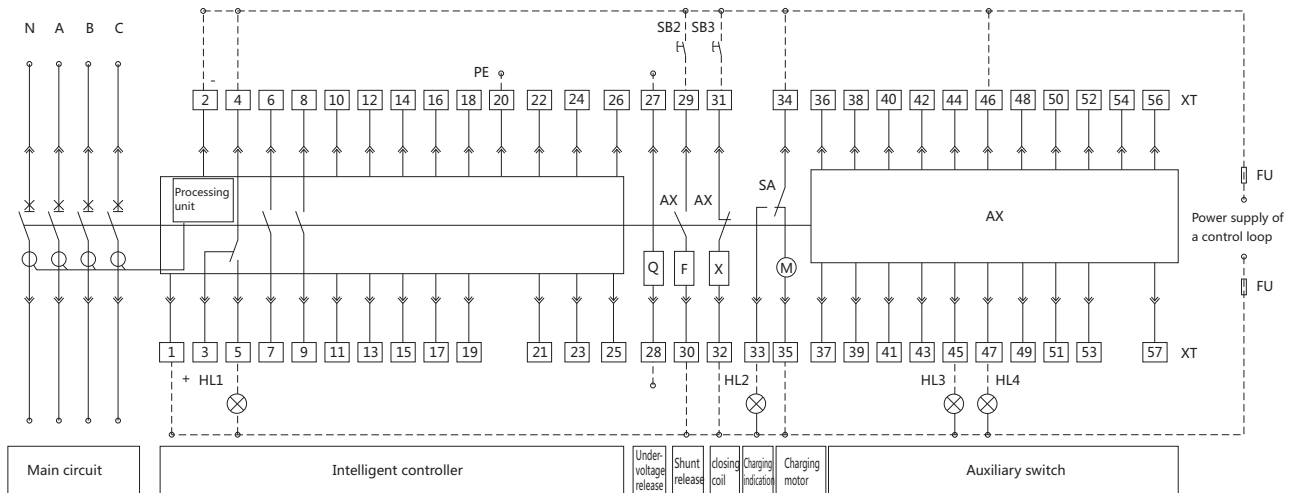

AX auxiliary contact type


For user

Four groups of adapters (Default)



2000-6300A frame


P/H type control unit

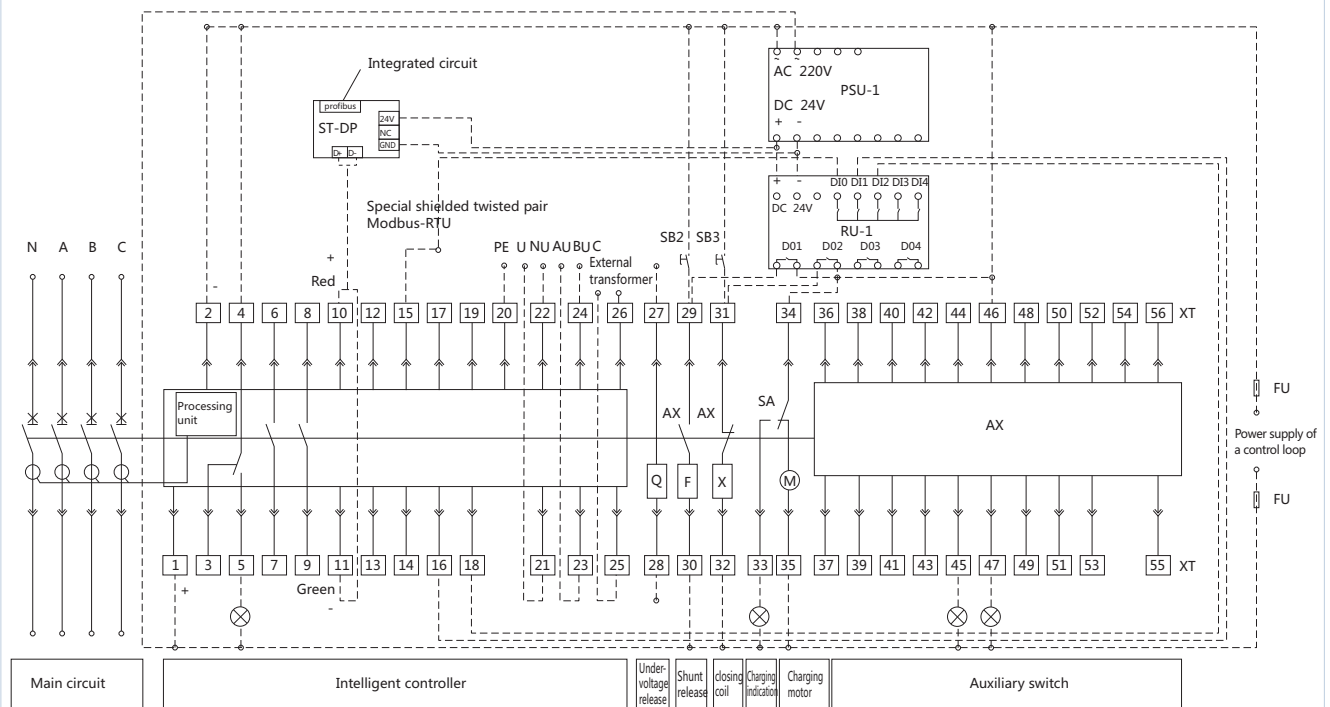


AX auxiliary contact type

For user


Four groups of adapters (Default five groups of adapters)

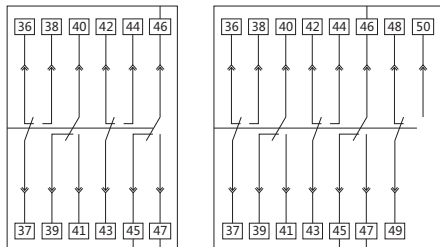

Three-open three-closed auxiliary contact



Four-open four-closed auxiliary contact Five-open five-closed auxiliary contact

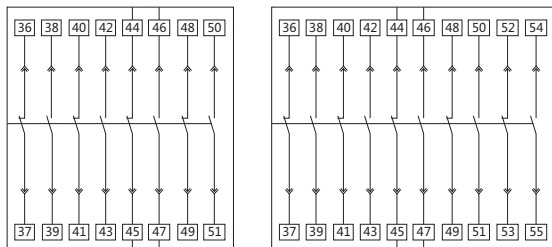

21#~24#: voltage display input signal contact

P/H type intelligent controller

21#: N-phase voltage signal, 22#: A-phase voltage signal

23#: B-phase voltage signal, 24#: C-phase voltage signal

25#~26#: External N-phase transformer or external earthing current transformer input signal contacts.

Conventional products are empty. When an external transformer is required for special order for users, they are external transformer signal input contacts.

27#, 28#: Undervoltage release (Connected to the main circuit or connected to the output of the undervoltage delay module)

29#, 30#: Shunt release, 31#, 32#: Closing coil, 33#, 34#: Charging indication

34#, 35#: Charging motor, 36#~56#: Auxiliary contact

Q-Undervoltage release F-Shunt release X-Closing coil
M-Charging motor SA-Limited switch XT-Wiring terminal
AX-Auxiliary contact SB1-Emergency stop button SB2-Tripping push button
SB3-Closing push button HL1-Failure indication lamp
HL2-Charging indication lamp HL3-Tripping indication lamp
HL4-Closing indication lamp FU-Fuse (6A) PSU-1—power module

1#, 2#: Power supply of intelligent controller

3#~5#: Tripping alarm contact (4-common point)

6#~9#: Auxiliary contact, normally open contact

10#~11#: Defaulted communication output contact for a H type intelligent controller.

P type is empty

12#~19#: Four groups of programmable output contacts

12#: com, 18 #:D01,16 #:D02,14 #:D03,13 #:D04

H type intelligent controller with a programmable output contact outputs in default:

12#, 13#: load 1 alarm, 12#, 14#: load 2 alarm, 12#,16#: tripping signal output,

12#, 18#: switching signal output.

P type intelligent controller with a programmable output contact outputs in default:

12#, 13#: load 1 alarm, 12#, 14#: load C alarm, 12#,16#: self-diagnosis alarm,

12#, 18#: failure tripping.

20#: PE line.

Conventional products are four groups of adapters. The three-open three-closed auxiliary contact, the four-open four-closed auxiliary contact, the five-open five-closed auxiliary contact, and five groups of adapters can be provided for the special order for users.

ST-DP: DP protocol module. When the upper computer communication protocol is Modbus-RTU, the ST-DP protocol module is not required. When the upper computer communication protocol is Profibus-DP, the Modbus-RTU protocol module is required to be converted into Profibus-DP protocol by the ST-DP protocol module, extra fee needed.

RU-1: relay module. The circuit breaker is used for breaking and making via remote control, and is used for breaking and making signal energy amplification, extra fee needed.

Note: 1. the full line section is connected, and the dot line should be connected by customers.


Note: 2. when the voltages of the controller of the 2000-4000 frame are AC 230V/AC 400V, the controller can be directly connected to 1#, 2#terminals.

When the voltage is DC 220V/DC 110V, the controller can be connected to

1#, 2# terminals after the power supply module outputs DC 24V.

Chassis position indicator device

Wiring diagram

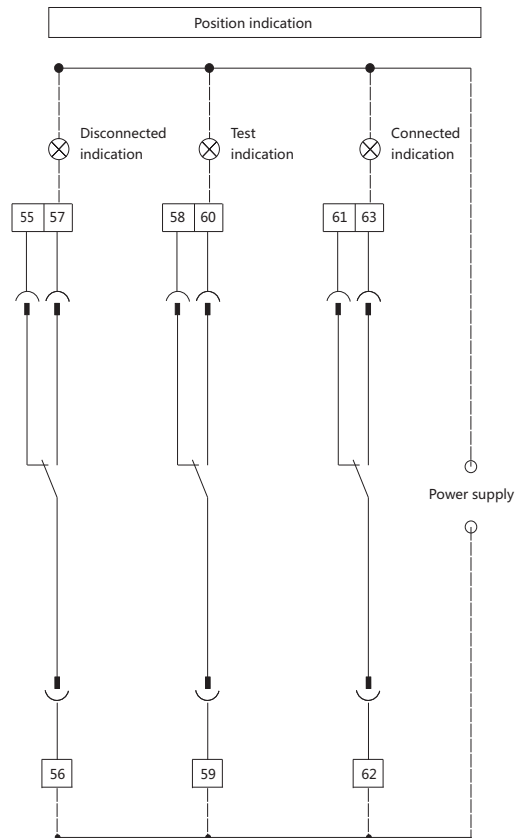

Operation requirements:

1. The chassis indication device can indicate the positions including "disconnected", "test" and "connected" which are completely or partially used according to the requirements of order.
2. When the body of the draw-out type circuit breaker is pushed from the "disconnected" position to the "test" position, 55# and 56# terminals should be transferred from connection into disconnection, and 56# and 57# terminals should be transferred from disconnection to connection.
3. When the body of the draw-out type circuit breaker is pushed from the "disconnected" position to the "test" position, 58# and 59# terminals should be transferred from connection into disconnection, and 59# and 60# terminals should be transferred from disconnection to connection. There is sufficient safety distance between the bus of the circuit breaker body and a bridge-type contact of the safety shutter, and tripping and switching operation can be carried out reliably.
4. When the body of the draw-out type circuit breaker is switched from the "test" position to the "connected" position, NXA16 type secondary circuit has no clearance. The NXA20-63 type safety shutter swing continuously after sending out the "cracking" sound, and the safety shutter jiggle handle rotates within 1.5 circles. 61# and 62# terminals are being transferred from connection to disconnection. 62# and 63# terminals are transferred from disconnection to connection. The busbar of circuit breaker body is required to be reliably inserted into the bridge-type contact of the chassis base, and reliably bear the main circuit current to operate.
5. When the body of the draw-out type circuit breaker is pushed from the "connected" position to the "test" position, 58# and 59# terminals should be transferred from connection into disconnection, and 59# and 60# terminals should be transferred from disconnection to connection. There is sufficient safety distance between the busbar of the circuit breaker body and a bridge-type contact of the chassis, and tripping and switching operation can be carried out reliably.
6. When the body of the draw-out type circuit breaker swings from the "test" position to the "disconnected" position, 55# and 56# terminals should be transferred from connection to disconnection, and 56# and 57# terminals should be transferred from disconnection to connection, and at the same time, the circuit breaker body still cannot be drawn out, and needs to swing toward the "disconnected" position until the handle cannot swing any more, and meanwhile, the circuit breaker body can be drawn out. After the circuit breaker is pulled out, 55# and 56# terminals should be transferred from disconnection to connection, and 56# and 57# terminals should be transferred from connection to disconnection.
7. In the position transfer operation process of the chassis, the operation can only be stopped when the indicator points to "disconnected", "test" and "connected" or the position indicator cannot display the position of the circuit breaker body in the chassis correctly.

Note: These number is used for position indicator only.

Annex I: Configuration

Standard configuration	1600A frame		2000A frame		3200A frame		4000A frame		6300A frame	
	Fixed type	draw-out type	Fixed type	draw-out type	Fixed type	draw-out type	Fixed type	draw-out type	Fixed type	draw-out type
Circuit breaker body	■	■	■	■	■	■	■	■	■	■
Chassis		■		■		■		■		■
Intelligent controller	■	■	■	■	■	■	■	■	■	■
Vertical and horizontal connection	■	■	■	■	■	■	■	■	■	■
ON/OFF indication contact 4CO	■	■	■	■	■	■	■	■	■	■
Failure tripping indication contact	■	■	■	■	■	■	■	■	■	■
Motor operating mechanism	■	■	■	■	■	■	■	■	■	■
Closing coil	■	■	■	■	■	■	■	■	■	■
Shunt release	■	■	■	■	■	■	■	■	■	■
Door frame	■	■	■	■	■	■	■	■	■	■

Optional accessories	1600A frame		2000A frame		3200A frame		4000A frame		6300A frame	
	Fixed type	draw-out type	Fixed type	draw-out type	Fixed type	draw-out type	Fixed type	draw-out type	Fixed type	draw-out type
Standard undervoltage release	■	■	■	■	■	■	■	■	■	■
Adjustable time-delay undervoltage unit	■	■	■	■	■	■	■	■	■	■
Pushbutton lock	■	■	■	■	■	■	■	■	■	■
"Disconnected" position padlock		■		■		■		■		■
Safety shutters padlock		■		■		■		■		■
Body lock	■	■	■	■	■	■	■	■	■	■
Position door interlock		■		■		■		■		■
State door interlock		■		■		■		■		■
ON/OFF indication contact 6CO	■	■								
ON/OFF indication contact 5NO + 5NC			■	■	■	■	■	■	■	■
ON/OFF indication contact 3NO + 3NC			■	■	■	■	■	■	■	■
ON/OFF indication contact 4NO+4NC			■	■	■	■	■	■	■	■
ON/OFF indication contact 5CO			■	■	■	■	■	■	■	■
"Connected", "Disconnected" and "test" position indication contact		■		■		■		■		■
Mechanical interlock	■	■	■	■	■	■	■	■	■	■
Source-changeover controller	■	■	■	■	■	■	■	■	■	■
External transformer (Neutral CT)	■	■	■	■	■	■	■	■	■	■
Earth current transformer and accessories thereof	■	■	■	■	■	■	■	■	■	■
Interphase barrier	■	■	■	■	■	■	■	■	■	■

Annex II: Selection table

Frame size	1600A			2000A			3200A			4000A			6300A
Circuit breaker	N <input type="checkbox"/>	S <input type="checkbox"/>	H <input type="checkbox"/>	N <input type="checkbox"/>	S <input type="checkbox"/>	H <input type="checkbox"/>	N <input type="checkbox"/>	S <input type="checkbox"/>	H <input type="checkbox"/>	N <input type="checkbox"/>	S <input type="checkbox"/>	H <input type="checkbox"/>	H <input type="checkbox"/>
Rated current	400A <input type="checkbox"/>			630A <input type="checkbox"/>			1600A <input type="checkbox"/>			3200A <input type="checkbox"/>			4000A <input type="checkbox"/>
	630A <input type="checkbox"/>			800A <input type="checkbox"/>			2000A <input type="checkbox"/>			3600A <input type="checkbox"/>			5000A <input type="checkbox"/>
	800A <input type="checkbox"/>			1000A <input type="checkbox"/>			2500A <input type="checkbox"/>			4000A <input type="checkbox"/>			6300A <input type="checkbox"/>
	1000A <input type="checkbox"/>			1250A <input type="checkbox"/>			3200A <input type="checkbox"/>						
	1250A <input type="checkbox"/>			1600A <input type="checkbox"/>									
	1600A <input type="checkbox"/>			2000A <input type="checkbox"/>									
Number of poles	3 pole <input type="checkbox"/>			4 pole <input type="checkbox"/> (While In=6300A , no four poles)									
Installation modes	Horizontal draw-out <input type="checkbox"/>						Fixed and horizontal <input type="checkbox"/>						
Intelligent controller	M type <input type="checkbox"/>		A type <input type="checkbox"/>		P type <input type="checkbox"/>		PT type <input type="checkbox"/>		H type <input type="checkbox"/>		HT type <input type="checkbox"/>		
Shunt release and motor operation	Closing coil <input type="checkbox"/>												
	AC220/230/240V <input type="checkbox"/>				AC380/400/415V <input type="checkbox"/>				DC110V <input type="checkbox"/>		DC220V <input type="checkbox"/>		
Undervoltage release (Match)	UVT <input type="checkbox"/> ASUVT <input type="checkbox"/>			UVTD <input type="checkbox"/> ASUVTD <input type="checkbox"/>									
	AC220/230/240V <input type="checkbox"/> 1s <input type="checkbox"/> 2s <input type="checkbox"/> 3s <input type="checkbox"/> 4s <input type="checkbox"/> 5s <input type="checkbox"/>			AC380/400/415V <input type="checkbox"/>									
Auxiliary contact	NXA16: C04 <input type="checkbox"/> C06 <input type="checkbox"/> (C06 only for AC) NXA20~63: N3 <input type="checkbox"/> N4 <input type="checkbox"/> N5 <input type="checkbox"/> C03 <input type="checkbox"/> C04 <input type="checkbox"/> C05 <input type="checkbox"/>												
Connection accessories	Interphase barrise <input type="checkbox"/>												
Controller accessories (Match)	External transformer: Earth current transformer <input type="checkbox"/>						External transformer (Neutral CT) <input type="checkbox"/>						
	Note: ¹⁾ Neutral CT is only applicable to 3P+N ²⁾ The earth current transformer should be selected when customers select earth current return type earthing protection.												
Lock mechanism (Match)	Pushbutton lock <input type="checkbox"/>			Safety shutters padlock <input type="checkbox"/>				Body lock <input type="checkbox"/>			One-lock one-key <input type="checkbox"/>		Two-locks one-key <input type="checkbox"/>
	Three-locks two-keys <input type="checkbox"/>			"Disconnected" position padlock <input type="checkbox"/>				Door interlock (Body) <input type="checkbox"/>			Door interlock (chassis) <input type="checkbox"/>		
Mechanical interlock (Match)	1 "Normal" and 1 "Replacement" <input type="checkbox"/>			2 "Incoming" and 1 "Busbar" <input type="checkbox"/>									
Source-changeover controller (Match)	1 "Normal" and 1 "Replacement" <input type="checkbox"/>			2 "Incoming" and 1 "Busbar" <input type="checkbox"/>									



Annex III: Earth fault protection

Earth protection

There are two protected modes for metal single-phase earth fault, namely vector sum(T) and earth current(W). Type-T detects zero sequence current and four-phase current vector(three-phase four-wire system) or three-phase current vector(three-phase three-wire system) will be added to provide reference for earth protection. Type-W detects earthing cable current directly by special external transformer. Type-W can protect both stages of breaker at the same time. Distance between the transformer and breaker should be no more than 5m. Zone interlocking can be used in the condition of vector sum earth fault.

a.correlation setting parameters of earth protection

Parameter Names	Setting range	Setting step size	Remarks
Set value of action current Ig	OFF+(0.2~1.0)×In (Frame NXA16/NXA20, Max= 1200A) OFF+(500A~1200A) (Frame NXA32/NXA40/NXA63)	1A	
delay time Tg	(0.1~0.4)S	0.1s	
Zone interlocking of earth fault (for T-type earth fault) (ZSI)	1.At least one way of DO should be set as "Zone Interlocking" or "earth Interlocking" 2.At least one way of DI should be set as "Zone Interlocking" or "earth Interlocking"		Signal unit options must be S2 or S3 When DI/DO is set as zone interlocking , it effects "Earth Zone Interlocking" and "Short Zone Interlocking" When DI/DO is set as earth interlocking, it only effects "earth Zone Interlocking" . If the function isn't set, it has no effect.

b. Operating characteristic of earth protection

Characteristic	I/Ig	Tripping time	Permissible error
Non-operating characteristic	< 0.9	Non-operate	
Operation characteristic	> 1.1	Operate	
Time-delay operation	≥ 1.1	Note	±15% or inherent absolute error±40ms(choose the max value)

Note: The delay time of earth fault is divided into two stages, inverse time and definite time. When fault current is less than 1.0In or 1200A,the protection is inverse, the time delay is calculated as follow:

$$t=(1.0I_n \text{ or } 1200A/I)^2 \times T_g$$

In this equation: t---action time

Tg --- setting delay time


I---fault earth current

Annex III: Earth fault protection


When fault current is more than $1.0I_n$ or 1200A, the protection is definite; the time delay is the setting delay time.

c. Schematic Diagram of detection

Type-T

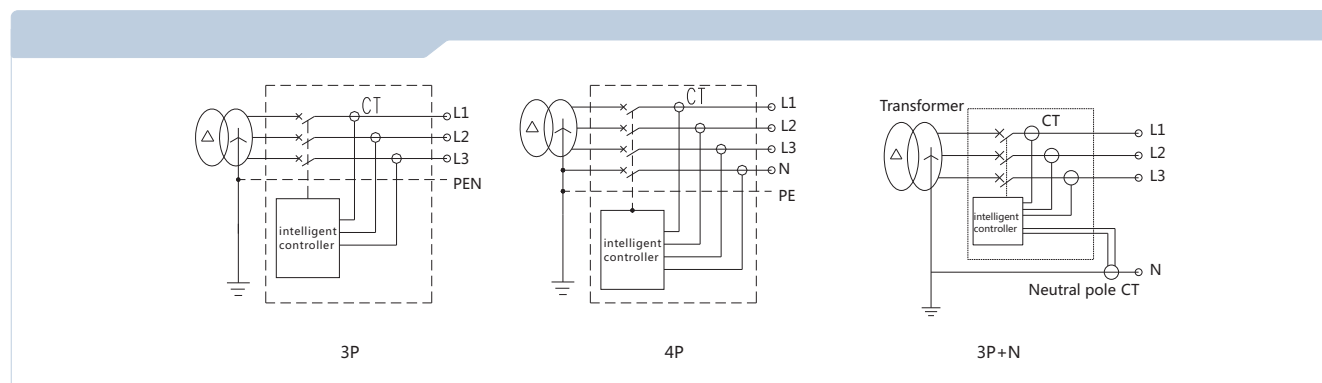

Type-W

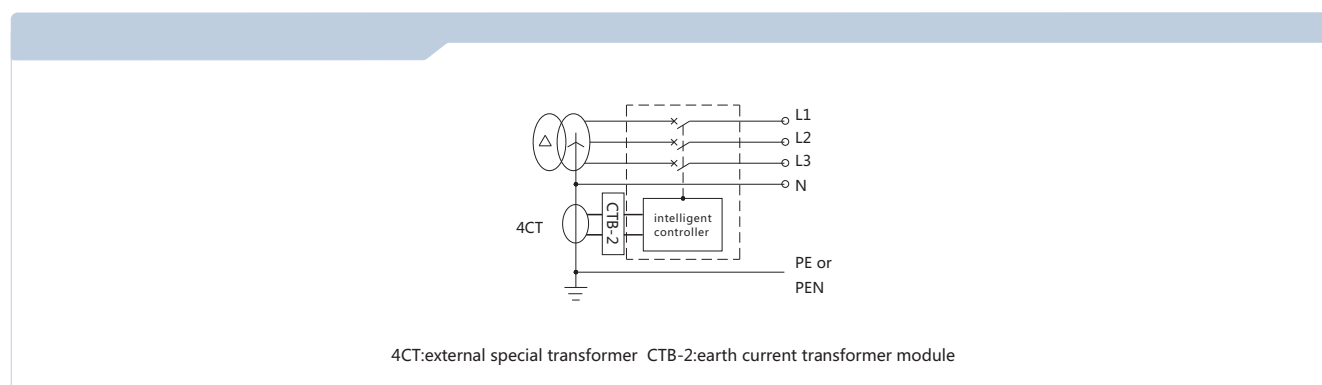

Leakage protection (E)

Leakage protection applies to leakage fault caused by insulation failure of equipment or human touching exposed electric conduction position. Leakage tripping current $I_{\Delta n}$ is independent of breaker rated current. An extra rectangular transformer is needed for zero sequence sampling method. This method is appropriate for small current protection because of its high accuracy and sensitivity.

a. correlation setting parameters of leakage protection


Parameter Names	Setting range	Setting step size
Set value of action current $I_{\Delta n}$	(0.5~30.0)A	0.1A
Delay time $T_{\Delta n}(S)$	Instantaneous , 0.06 , 0.08 , 0.17 , 0.25 , 0.33 , 0.42 , 0.5 , 0.58 , 0.67 , 0.75 , 0.83	
Operation mode	Trip/Turn off	

b. Operating characteristic of leakage protection

Characteristic	$I/I_{\Delta n}$	Tripping time	Permissible error
Non-operating characteristic	< 0.8	Non-operate	
Operation characteristic	> 1.0	Operate	
Time-delay operation	≥ 1.0	Shown in Table 18	$\pm 10\%$ (inherent absolute error $\pm 40ms$)


Setting time(s)	0.06	0.08	0.17	0.25	0.33	0.42	0.5	0.58	0.67	0.75	0.83	Instantaneous
Multiple of Fault Current	Maximum Breaking Time(s)											
1 $I_{\Delta n}$	0.36	0.5	1	1.5	2	2.5	3	3.5	4	4.5	5	0.04
2 $I_{\Delta n}$	0.18	0.25	0.5	0.75	1	1.25	1.5	1.75	2	2.25	2.5	0.04
5 $I_{\Delta n}$	0.072	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1	0.04
10 $I_{\Delta n}$												

c. Schematic Diagram of leakage protection

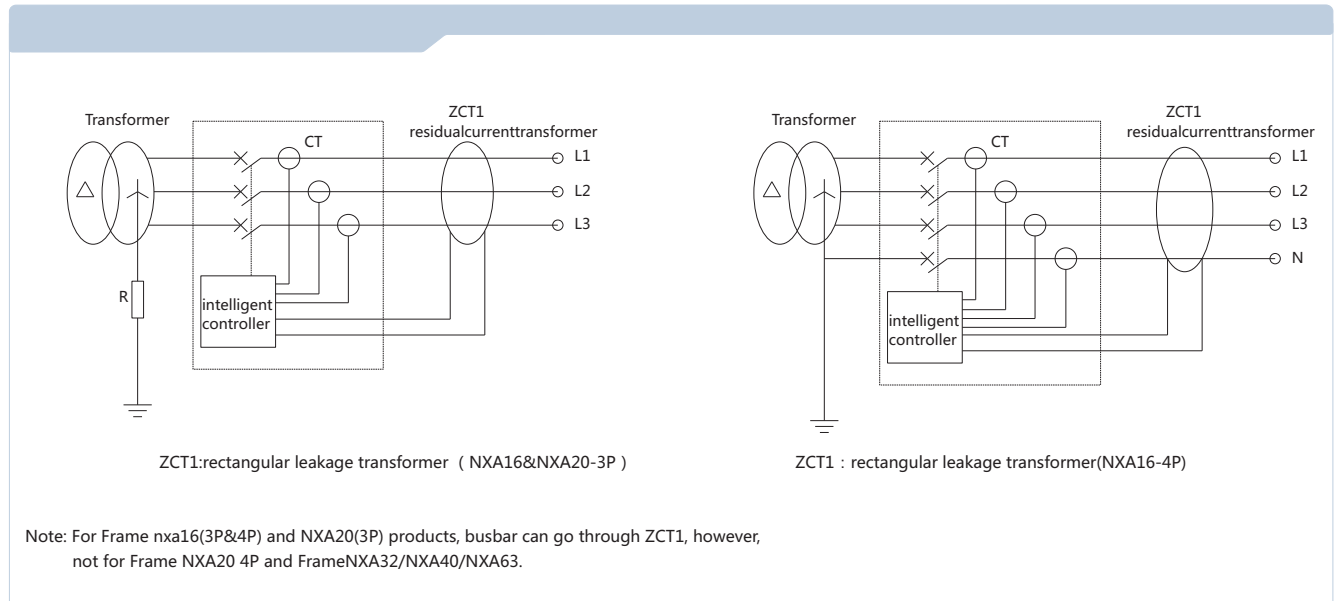

Dual earth fault protection

NXA P/H type controller has a unique feature: the installation of two independent earth fault protection curves is permissible, so that two kinds of configurations can be managed at the same time. The release can differentiate unlimited regional earth faults because of the feature to command the NXA circuit breaker to trip and the limited regional earth fault to command the medium-voltage circuit breaker to strip.

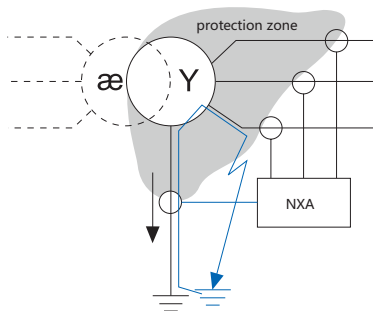


Annex IV: Source-changeover controller

Functions of the controller

2A type display and operation

CD-1: A 2A type source-changeover system is used for the switch between power grids or between the power grid and generator. When a normal power supply does not supply power normally, such as undervoltage, overvoltage, phase breaking, a spare power supply is switched for supplying power. A mechanical interlock component is configured according to standard.

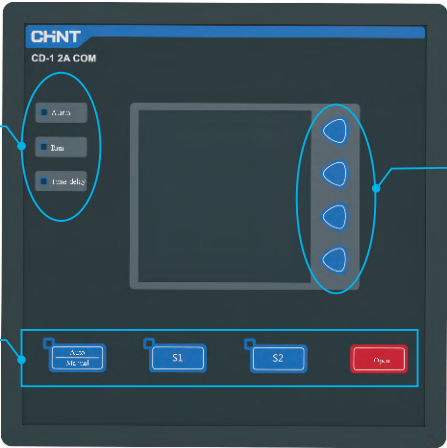

Switch operation zone	Automatic (The system judges the operateion automatically, and the light is on when pressing the left upper part)
	Manual (The mechanism is operated by a handle or with buttons S1, S2 and OFF operation)
	S1:load is powered by switching to S1, and the light is on when pressing S1 in the left upper part.
	S2: load is powered by switching to S2, and the light is on when pressing S2 in the left upper part.
	Disconnection: S1, S2 are stripped, and the system load is not powered
Pressing anyone of buttons S1, S2 and OFF under the automatic condition, the system becomes manual, and corresponding operation is carried out when pressing corresponding buttons.	

2A type of functions

- The controller has the following functions
1. Dual-circuit voltage detection display
 2. Overvoltage threshold value adjustment: 400V-480V
 3. Undervoltage threshold value adjustment: 280V-360V
 4. Adjustment of T1, T2, T3 and T4: 0.5-64S with the step size of 0.5S
 5. Undervoltage and overvoltage fault indication
 6. Power supply fault indication
 7. State indication of the circuit breaker
 8. Self-input and self-reset or self-input and self-reset selection
 9. Manual or automatic selection
 10. Comprehensive alarm for transfer failure (fault of the circuit breaker, sending fault of control signals and unmet transfer conditions)
 11. All primary adjustment states after resetting and before defaulting
 12. Alarm contact
 13. Unloading contact
 14. Startup contact of a power generator
 15. Standard configuration
 16. Mechanical interlock
 17. The controller has an overvoltage protection function, and operates normally with long-term overvoltage: 130% Ue.


Truth table

S1-circuit power supply	S2-circuit power supply
1	0
0	0
0	1

Annex IV: Source-changeover controller

3A type display and operation

CD-1 A 3A source-changeover system is applicable to a power supplying system with two power supplies and one buscouple. In the manual operation process, load cannot lead to power interruption, so that the safety running level and the power supplying continuity for power distribution are enhanced. The 3A automatic power supply conversion system is applied to electric places.

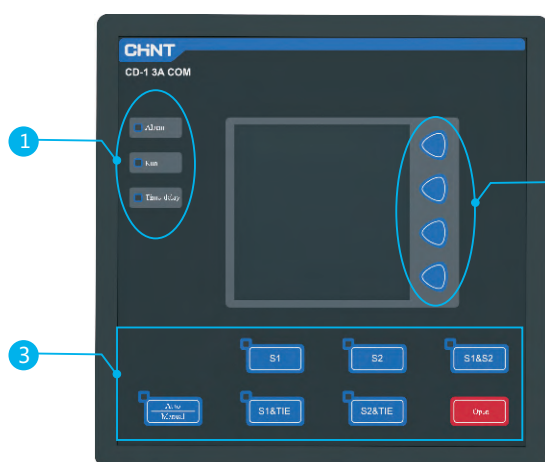

Automatic (The system judges the operation automatically, and the light is on when pressing the left upper part)

Manual (The mechanism is operated by a handle or with buttons S1, S2, S1 & S2, S1 & TIE, S2&TIE and OFF operation)

S1: load is powered by switching to S1, the TIE buscouple is tripped, and the light is on at the left upper part when pressing S1.

S2: load is powered by switching to S2, the TIE buscouple is tripped, and the light is on at the left upper part when pressing S2.

S1 & S2: Load is powered by S1 & S2, TIE buscouple is tripped; the light is on at the left upper part when pressing S1 & S2.

S1&TIE: Load is powered by S1, TIE buscouple is tripped; the light is on at the left upper part when pressing S1&TIE

S2&TIE: Load is powered by S2, TIE buscouple is tripped; the light is on at the left upper part when pressing S2&TIE

Disconnection: S1, S2 and TIE are all tripped, and the system load is not powered.

Pressing anyone of buttons S1, S2 S1 & S2, S1&TIE, S2&TIE under the automatic condition, the system becomes manual, and corresponding operation is carried out when pressing corresponding buttons.

3A type functions

The controller has the following functions

1. Dual-circuit voltage detection display
2. Overvoltage threshold value adjustment: 400V-480V
3. Undervoltage threshold value adjustment: 280V-360V
4. Adjustment of T1, T2, T3 and T4: 0.5-64S with the step size of 0.5S
5. Undervoltage and overvoltage fault indication
6. Power supply fault indication
7. State indication of the circuit breaker
8. Self-input and self-reset or self-input and self-reset selection
9. Manual or automatic selection
10. Comprehensive alarm for transfer failure (fault of the circuit breaker, sending fault of control signals and unmet transfer conditions)
11. All primary adjustment states after resetting and before defaulting
12. Alarm contact
13. Unloading function
14. Standard configuration
15. Mechanical interlock
16. The controller has an overvoltage protection function, and operates normally with long-term overvoltage: 130% Ue.

Truth table

S1-circuit power supply	TIE buscouple	S2-circuit power supply
1	0	1
1	1	0
0	1	1
1	0	0
0	0	1
0	0	0

Note

Note

[illegible]

Note

[illegible]